




**ERIE COUNTY WATER AUTHORITY**  
**INTEROFFICE MEMORANDUM**

December 9, 2024

To: Terrence D. McCracken, Secretary to the Authority

From: Michael J. Quinn, PE, Senior Distribution Engineer 

Subject: Contract MP-088  
Sturgeon Point WTP Washwater Tank Replacement  
Change Order No. 2: Additional Excavation and Backfill  
ECWA Project No. 202100111

---

Attached is Change Order No. 2 pertaining to the above-referenced contract. The change order pertains to a change in the contract price associated with additional excavation required to achieve an acceptable subgrade for the tank foundation.

On April 6, 2023, the Erie County Water Authority entered into a contract with DN Tanks of New York, LLC (DN Tanks) for the construction of a new washwater storage tank at the Sturgeon Point Water Treatment Plant. The tank design utilized a series of borings in the area of the new tank. Not surprisingly, the elevation of suitable soils differed from what was anticipated resulting in the need to over excavate the soil and replace it with suitable material.

This Change Order will compensate DN Tanks for the additional \$56,385.85 for the work. After a review of the additional costs, the Authority's design consultant and the Engineering Department staff collectively feel that the additional cost is reasonable. Funds for this change order are available as follows:

- Unit 2510 – Engineering/Construction Sturgeon Point
- Item 101608 – Washwater Tank Replacement

MJQ:jmf

Attachments

cc: L.Kowalski, PE

CONT-MP-088-2101-X-14

ERIE COUNTY WATER AUTHORITY  
 AUTHORIZATION FORM  
 For Approval/Execution of Documents  
 (check which apply)

**Contract:** MP-088 **Project No.:** 202100111  
**Project Description:** Washwater Tank Replacement at Sturgeon Point WTP

**Item Description:**








Agreement     Professional Service Contract     Amendment     Change Order  
 BCD     NYSDOT Agreement     Contract Documents     Addendum  
 Recommendation for Award of Contract     Recommendation to Reject Bids  
 Request for Proposals  
 Other \_\_\_\_\_

**Action Requested:**


Board Authorization to Execute     Legal Approval  
 Board Authorization to Award     Execution by the Chairman  
 Board Authorization to Advertise for Bids     Execution by the Secretary to the Authority  
 Board Authorization to Solicit Request for Proposals  
 Other \_\_\_\_\_

**Approvals Needed:**

**APPROVED AS TO CONTENT:**

<input checked="" type="checkbox"/> Sr Distribution Engineer		Date: <u>12/9/2024</u>
<input checked="" type="checkbox"/> Chief Operating Officer		Date: <u>12/09/2024</u>
<input checked="" type="checkbox"/> Executive Engineer		Date: <u>12/9/2024</u>
<input checked="" type="checkbox"/> Director of Administration		Date: <u>12/9/2024</u>
<input checked="" type="checkbox"/> Risk Manager		Date: <u>12/9/2024</u>
<input checked="" type="checkbox"/> Chief Financial Officer		Date: <u>12/09/2024</u>
<input checked="" type="checkbox"/> Legal		Date: <u>12/09/2024</u>

**APPROVED FOR BOARD RESOLUTION:**

<input checked="" type="checkbox"/> Secretary to the Authority		Date: <u>12/9/2024</u>
--	--	------------------------

**Remarks:** Change Order #2

**Resolution Date:** \_\_\_\_\_ **Item No:** \_\_\_\_\_

**CHANGE ORDER NO.: G-02**

Owner: Erie County Water Authority                      Owner's Project No.: 202100111  
Engineer: Arcadis of New York, Inc.                      Engineer's Project No.: 30076280  
Contractor: DN Tanks    Contractor's Project No.: 2023-003  
Project: Sturgeon Point Water Treatment Plant Washwater Tank Replacement  
Contract Name: MP-088  
Date Issued: 11/26/2024                                      Effective Date of Change Order: 12/13/2024

The Contract is modified as follows upon execution of this Change Order:

**Description:**

This Change Order results in an increase in the Contract Price for Contract MP-088. The additional costs account for the Contractors time and material cost documentation for over excavation, disposal, and backfill of an additional 16-inches of material below the tank foundation. The required 16-inches of over excavation was required based on field observations at the time of excavation by the geotechnical engineer of record for the Project.


- **Modification GCP-005, Additional Tank Undercut and Disposal:** Increase of \$56,385.85 to Bid Item No. 1 General Construction for general construction of Washwater Tank Replacement, Contract MP-088.

**Attachments:**

- GCP-005 – Modification Response Letter – 11/20/2024

**CHANGE ORDER NO.: G-02**

Change in Contract Price	Change in Contract Times
Original Contract Price: \$ <u>3,530,700.00</u>	Original Contract Times: Substantial Completion: <u>12/1/2023</u> Ready for final payment: <u>5/21/2024</u>
Increase from previously approved Change Orders No. G-01 to No. G-01: \$ <u>97,645.90</u>	Increase from previously approved Change Orders No. G-01 to G-02: Substantial Completion: <u>365 Calendar Days</u> Ready for final payment: <u>365 Calendar Days</u>
Contract Price prior to this Change Order: \$ <u>3,628,345.90</u>	Contract Times prior to this Change Order: Substantial Completion: <u>12/1/2024</u> Ready for final payment: <u>5/21/2025</u>
Increase this Change Order: \$ <u>56,385.85</u>	Increase this Change Order: Substantial Completion: <u>N/A</u> Ready for final payment: <u>N/A</u>
Contract Price incorporating this Change Order: \$ <u>3,684,731.75</u>	Contract Times with all approved Change Orders: Substantial Completion: <u>12/1/2024</u> Ready for final payment: <u>5/21/2025</u>

Recommended by Engineer (if required)		Accepted by Contractor	
By:		_____	_____
Title:	Project Manager	_____	_____
Date:	11/27/2024	_____	_____
Authorized by Owner		Approved by Funding Agency (if applicable)	
By:	_____	_____	_____
Title:	_____	_____	_____
Date:	_____	_____	_____

Mr. Curtis Knapton, P.E.  
Project Manager  
DN Tanks  
11 Teal Road  
Wakefield, MA 01880

Arcadis of New York, Inc.  
50 Fountain Plaza  
Suite 360  
Buffalo, NY 14202  
United States  
Phone: 716 667 0900  
[www.arcadis.com](http://www.arcadis.com)

Date: November 20, 2024

Our Ref: 30076280

Subject: STP WTP Washwater Tank Replacement

ECWA Project No. 202100111

Contract No. MP-088

Modification No. GCP-005, Additional Tank Undercut and Disposal

Dear Mr. Knapton,

Arcadis of New York, Inc has reviewed the DN Tanks proposal for Modification No. GCP-005 – Additional Tank Undercut and Disposal (copy attached), dated September 13, 2024. This proposal accounts for DN's reported overexcavation, disposal, and backfill of an additional 16-inches of material below the tank foundation. The required 16-inches of overexcavation was required based on field observations at the time of excavation by the geotechnical engineer of record for the Project, see attached field report. Arcadis has reviewed the actual field elevations of the depth of excavation and concluded that the overexcavation was outside the scope of work included in the Contract Documents, see calculations attached. Therefore, the proposed cost based on the provided time and material tickets is acceptable and will be included in the next Change Order prepared for your contract, increasing the Contract price by \$56,385.85 for this work with no change in Contract Time.

Please contact me if you should have any questions concerning this modification or any other aspects of this project.

Sincerely,

Arcadis of New York, Inc.



Mr. Matthew J. Czora, PE  
Principal Engineer

Email: [matt.czora@arcadis.com](mailto:matt.czora@arcadis.com)

Direct Line: 585.662.4055

Mobile: 585.314.6388

Mr. Curtis Knapton, P.E.  
DN Tanks  
November 20, 2024

CC. Mr. Michael Quinn, PE, BCEE, Erie County Water Authority  
Mr. Michael Wymer, PE, Erie County Water Authority  
Mr. David Patton, PE, Erie County Water Authority  
Mr. Bill Weir, Erie County Water Authority  
Mr. Cameron Daley, Arcadis of New York, Inc  
Mr. Justin Francis, Arcadis of New York, Inc  
Mr. Ed Skalny, DN Tanks

Enclosures: Modification No. GCP-005 – Additional Tank Undercut and Disposal, dated 9/13/2024  
Geotechnical Engineer Field Report, dated 7/29/2024  
Structural Fill Material Calculations



**BUILT**  
FOR THE FUTURE

September 13, 2024

Matt Czora  
Arcadis of New York, Inc.  
100 Chestnut Street, Suite 1020  
Rochester, NY 14604

Reference: Contract MP-088: Sturgeon Point Water Treatment Plant Washwater Tank  
Replacement  
Project No. 20210011  
Derby, NY

Mr. Czora,

Based on the direction provided by the Geotech engineer during tank subgrade excavation in which DN Tanks and STC Construction were directed to lower the tank subgrade elevation by an additional 16", please see the attached change order proposal and supplementary information related to the cost associated with this work.

This proposal includes the T&M slips for the work completed to excavate and remove the additional 16" of undercut material. These are attached for your review.

The total cost of the change order is \$56,385.85 including DN Tanks' allowable mark-up of 5%.

Please feel free to contact me at 781-621-5015 if you have any questions concerning this proposal.

Sincerely,

Curtis Knapton  
Project Manager

Attachments:

- STC Construction T&M Slips for additional 16" of tank undercut work



**STC Construction, Inc.**  
 P.O. Box 459, 63 Zoar Valley Road  
 Springville, New York 14141-0459

<b>Invoice</b>	
<b>Invoice No.</b>	<b>2306.002</b>
<b>Date</b>	7/31/2024
<b>Billing Period</b>	5/30/2024 - 6/11/2024
<b>Page</b>	1

**Bill To:**

DN Tanks  
 11 Teal Road  
 Wakefield, MA 01880

**Remit To:**

STC Construction, Inc.  
 P.O. Box 459  
 Springville, New York 14141

<b>Contract / PO No.</b>	<b>Description of Work</b>			<b>Customer ID</b>	<b>STC Project No.</b>
	Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation			DNT001	2306
<b>Date</b>	<b>Labor</b>	<b>Owned Eqpt</b>	<b>Matl &amp; Rented Eqpt</b>	<b>Subs / Services</b>	<b>Subtotal</b>
05-30-2024	949.03	501.32	496.80	0.00	1,947.15
06-03-2024	1,308.45	483.26	3,704.50	0.00	5,496.21
06-04-2024	1,089.35	483.26	986.70	0.00	2,559.31
06-05-2024	3,796.10	1,981.94	9,133.89	0.00	14,911.93
06-06-2024	3,796.10	1,719.11	12,171.58	0.00	17,686.79
06-07-2024	1,089.35	492.32	2,026.44	0.00	3,608.11
06-10-2024	1,563.86	990.48	2,760.46	0.00	5,314.80
06-11-2024	614.84	246.16	1,315.51	0.00	2,176.51
	-				-
<b>Subtotals:</b>	14,207.08	6,897.85	32,595.88	0.00	\$ 53,700.81
				OH & Profit %	\$ -
<b>Payment Terms: Net 30</b>				<b>TOTAL INVOICE:</b>	<b>\$ 53,700.81</b>
				<b>Retention:</b>	<b>\$ -</b>
				<b>Total Due Less Retention:</b>	<b>\$ 53,700.81</b>

A Finance Charge of 1.5% per month will be charged to those bills not paid within 30 days of due date. Unless written notice is received within 30 days, customer agrees to pay all charges listed above.





**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY      **CUSTOMER:** DN Tanks  
**ACTIVITY:** Excavate down to subgrade; organic soils found; excavate another 16" to find virgin ground.

**SHT No:** 2154  
**DATE:** 05-30-2024  
**TEMP:** \_\_\_\_\_ deg F  
**WTHR:** Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT	
		START	END		\$ / HR	ST,OT,DT		
Michael Allen	Superintendent			2	122.02	ST	244.04	
Don Lulas	Operator			2	115.18	ST	230.36	
Dennis Nopper	Laborer			2	87.71	ST	175.42	
Rick Emke	Laborer			2	87.71	ST	175.42	
							-	
							-	
							-	
							-	
							-	
<b>SUBTOTAL</b>								825.24
15% OH&P								123.79
<b>TOTAL</b>								949.03

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				2	125.00	2		250.00
2019 CAT 299D2 Skidsteer w/ broom (E89)				2	43.75			87.50
2010 F-250 Super Duty 4x4 (T10)				2	35.53	2		71.06
2022 Ram 5500 Crew 6x4 (T51)				2	46.38	2		92.76
								-
								-
								-
<b>SUBTOTAL</b>								501.32
0% OH&P								-
<b>TOTAL</b>								501.32

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC70 Roller (1 op hour)	Admar Supply	BU2071609	162.00
			-
			-
			-
			-
			-
			-
<b>SUBTOTAL</b>			432.00
15% OH&P			64.80
<b>TOTAL</b>			496.80

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-
						-
<b>SUBTOTAL</b>						-
15% OH&P						-
<b>TOTAL</b>						-

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

<b>SHEET TOTAL</b>	<b>1,947.15</b>
--------------------	-----------------

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.

PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
Springville, New York 14141 FX (716) 592-4367

TIME & MATERIAL RECORD /  
EXTRA WORK AUTHORIZATION

PROJECT: WAST WATER TANK SHT No: 2154  
 LOCATION: Sturgeon Point, Delco NY CUSTOMER: DN TANKS DATE(s): 5/30/24  
 ACTIVITY: Excavate Down to subgrade, organic soils Found, Excavate another 16" to find virgin ground. TEMP: \_\_\_\_\_ deg F  
 WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST,OT,DT	\$/HR	
Michael Allen		Supt			2	-	-	-
Don Lulas		Operator			2	-	-	-
Dennis Nopper		Laborer			2	-	-	-
Rick Emke		II			2	-	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	OWNED EQUIPMENT				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335 Excavator w/3 Buckets					-	2	-	-
2019 CAT 304 Excavator w/3 Buckets					-	-	-	-
2019 CAT 299 SkidSteer w/Broom					-	-	-	-
2010 F-250 Super Duty 4x4					-	2	-	-
2022 RAM 5500 CREW CAB					-	2	-	-
2019 CAT D5 Dozer					-	1	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	MATERIAL & RENTED EQUIPMENT		VENDOR / SUPPLIER	INVOICE NO.	AMOUNT	
	DESCRIPTION	RENTAL				
WACKER	Newson	RC 70 Roller	Admar		-	
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT	
		START	END	HRS			
						SUBTOTAL	-
						% OH&P	-
						TOTAL	-

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

SHEET TOTAL

AUTHORIZATION (Print/Sign) [Signature] / ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY      **CUSTOMER:** DN Tanks  
**ACTIVITY:** Excavate additional 16" down to virgin ground per Arcadis, and haul off site.

**SHT No:** 2155  
**DATE:** 06-03-2024  
**TEMP:**                                  deg F  
**WTHR:**      Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT	
		START	END		\$ / HR	ST,OT,DT		
Michael Allen	Superintendent			3	122.02	ST	366.06	
Don Lulas	Operator			2	115.18	ST	230.36	
Dennis Nopper	Laborer			2	87.71	ST	175.42	
Rick Emke	Laborer			2	87.71	ST	175.42	
Louie Fanara	Teamster			2	95.26	ST	190.52	
							-	
							-	
							-	
							-	
							-	
<b>SUBTOTAL</b>								<b>1,137.78</b>
15% OH&P								<b>170.67</b>
<b>TOTAL</b>								<b>1,308.45</b>

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				2	116.00	2		232.00
2019 CAT 299D2 Skidsteer w/ broom (E89)				2	43.75	1	-	87.50
2010 F-250 Super Duty 4x4 (T10)				2	35.53	2	-	71.06
2022 Ram 5500 Crew 6x4 (T51)				2	46.35	2		92.70
								-
								-
<b>SUBTOTAL</b>								<b>483.26</b>
0% OH&P								<b>-</b>
<b>TOTAL</b>								<b>483.26</b>

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
2019 CAT D5 Dozer	Universal Engine	1389	270.00
Wacker Neuson RC70 Roller	Admar Supply	BU2071609	162.00
Mack Triaxle Dump Truck	Gernatt	1818	2,789.30
			-
			-
			-
			-
			-
			-
<b>SUBTOTAL</b>			<b>3,221.30</b>
15% OH&P			<b>483.20</b>
<b>TOTAL</b>			<b>3,704.50</b>

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-
						-
<b>SUBTOTAL</b>						<b>-</b>
15% OH&P						<b>-</b>
<b>TOTAL</b>						<b>-</b>

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

15% OH&P	-
<b>TOTAL</b>	-
<b>SHEET TOTAL</b>	<b>5,496.21</b>

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

**TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

PROJECT: WASH WATER TANK SHT No: 2155  
 LOCATION: STURGAON POINT, DERBY NY CUSTOMER: DN TANKS DATE(s): 6/3/24  
 ACTIVITY: Excavate Additional ~~36~~ Down To TEMP: \_\_\_\_\_ deg F  
VIRGIN GROUND PER ARCADIS AND HAUL OFF SITE WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME		HRS	RATE		AMOUNT
			START	END		ST. OT. DT	\$/HR	
Michael Allen		Supt			3	-	-	-
Don Lulas		Operator			2	-	-	-
Dennis Nopper		Laborer			2	-	-	-
Rick Emke		"			2	-	-	-
Louie Farnara		Teamster			2	-	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	OWNED EQUIPMENT		TIME ON SITE				OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR	RATE				
2019 CAT 335 w/3 Buckets							2	-	
2019 CAT 304 w/3 Buckets								-	
2019 CAT 299 Skidsteer w/Broom							1	-	
<del>2019 CAT 05 Dozer - Rental</del>								-	
2010 F-250 Super Duty 4x4							2	-	
2022 Ram 5500 Crew Cab							2	-	
							SUBTOTAL	-	
							% OH&P	-	
							TOTAL	-	

DESCRIPTION	MATERIAL & RENTED EQUIPMENT		VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC 70 Roller			Admar		-
2019 CAT 05 Dozer			Universal Engine		-
MACK Triaxle Dump Truck			Gervatt Gravel		-
Owned Equipment					-
Magnum Light Tower / Generator					-
					-
					SUBTOTAL
					% OH&P
					TOTAL

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			HRS	INVOICE NO.	AMOUNT
		START	END				
							-
							-
							-
							SUBTOTAL
							% OH&P
							TOTAL

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

SHEET TOTAL

AUTHORIZATION (Print/Sign)  ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY **CUSTOMER:** DN Tanks  
**ACTIVITY:** Excavate unsuitable spoils as directed by Arcadis approximately extra 16"  
and 4' wider diameter.

**SHT No:** 2156  
**DATE:** 06-04-2024  
**TEMP:** \_\_\_\_\_ deg F  
**WTHR:** Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT
		START	END		\$ / HR	ST,OT,DT	
Michael Allen	Superintendent			3	122.02	ST	366.06
Don Lulas	Operator			2	115.18	ST	230.36
Dennis Nopper	Laborer			2	87.71	ST	175.42
Rick Emke	Laborer			2	87.71	ST	175.42
							-
							-
							-
							-
							-

**SUBTOTAL** 947.26  
 15% OH&P 142.09  
**TOTAL** 1,089.35

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				2	116.00	2		232.00
2019 CAT 299D2 Skidsteer w/ broom (E89)				2	43.75	1		87.50
2010 F-250 Super Duty 4x4 (T10)				2	35.53	2		71.06
2022 Ram 5500 Crew 6x4 (T51)				2	46.35	2		92.70
								-
								-

**SUBTOTAL** 483.26  
 0% OH&P -  
**TOTAL** 483.26

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC70 Roller	Admar Supply	BU2071609	162.00
Triaxle Dump Truck	Iroquois Bar	55049	426.00
			-
			-
			-
			-
			-

**SUBTOTAL** 858.00  
 15% OH&P 128.70  
**TOTAL** 986.70

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-
						-

**SUBTOTAL** -  
 15% OH&P -  
**TOTAL** -

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

**SHEET TOTAL** 2,559.31

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION

PROJECT: WASH WATER TANK SHT No: 2156  
 LOCATION: Sturgeon Point, Delby NY CUSTOMER: DN TANKS DATE(s): 6/4/24  
 ACTIVITY: Excavate unsuitable spoils As Directed TEMP: \_\_\_\_\_ deg F  
By ARCADIS APPROXIMATELY EXTRA 15" AND 4" WIDER DIAMETER WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST,OT,DT	\$/HR	
Michael Allen		SUPT			3	-	-	-
Don Lukas		OPERATOR			2	-	-	-
Dennis Nopper		LABORER			2	-	-	-
Rick Emke		LABORER			2	-	-	-
						SUBTOTAL		-
						% OH&P		-
						TOTAL		-

DESCRIPTION	OWNED EQUIPMENT				TIME ON SITE		OPER		AMOUNT
	MO	WK	DAY	HR	RATE	HRS	RATE		
2019 CAT 335 Excavator w/3 Buckets					-	2	-	-	
2019 CAT 304 Excavator w/3 Buckets					-	-	-	-	
2019 CAT 299 <del>Excavator</del> SK Steer + Bloom					-	1	-	-	
2010 F-250 Super Duty 4x4					-	2	-	-	
2022 RAM 5500 Crew Cab 6x4					-	2	-	-	
Magnum Light Tower / Generator					-	-	-	-	
						SUBTOTAL		-	
						% OH&P		-	
						TOTAL		-	

DESCRIPTION	MATERIAL & RENTED EQUIPMENT		VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
	MO	WK			
Wacker Newson RC 70 Roller			Admar		-
2019 D5 Dozer			Universal Engine		-
TRIAXLE Dump Truck			IRIQUOIS		-
					SUBTOTAL
					% OH&P
					TOTAL

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
					SUBTOTAL	
					% OH&P	
					TOTAL	

CUSTOMER APPROVAL AND ACCEPTANCE: The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

\_\_\_\_\_  
 % OH&P  
 TOTAL  
**SHEET TOTAL**

AUTHORIZATION (Print/Sign) [Signature] / ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.

PO Box 459, 63 Zoar Valley Road  
Springville, New York 14141

DAILY TIME & MATERIAL RECORD /  
EXTRA WORK AUTHORIZATION

PROJECT: Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
LOCATION: Sturgeon Point, Derby, NY CUSTOMER: DN Tanks  
ACTIVITY: Excavate unsuitable soils and haul off site; install additional 2" crusher run.

SHT No: 2157  
DATE: 06-05-2024  
TEMP: \_\_\_\_\_ deg F  
WTHR: Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT
		START	END		\$ / HR	ST,OT,DT	
Michael Allen	Superintendent			8	122.02	ST	976.16
Don Lulas	Operator			8	115.18	ST	921.44
Dennis Nopper	Laborer			8	87.71	ST	701.68
Rick Emke	Laborer			8	87.71	ST	701.68
							-
							-
							-
							-
							-

SUBTOTAL 3,300.96  
15% OH&P 495.14  
TOTAL 3,796.10

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)			1		925.00	8		925.00
2019 CAT 299D2 Skidsteer w/ broom (E89)			1		676.00			676.00
2010 F-250 Super Duty 4x4 (T10)			1		39.05	2		39.05
2022 Ram 5500 Crew 6x4 (T51)			1		305.66	2		305.66
Magnum Light Tower (E45)			1		36.23	2		36.23

SUBTOTAL 1,981.94  
0% OH&P -  
TOTAL 1,981.94

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC70 Roller (3 op hours)	Admar Supply	BU2071609	162.00
(3) Triaxle Dump Trucks	Iroquois Bar	55049	2,094.50
(8) loads 2" crusher run	Iroquois Bar	55015	2,329.08
hauling charges for aggregate	Iroquois Bar	55049	3,086.93

SUBTOTAL 7,942.51  
15% OH&P 1,191.38  
TOTAL 9,133.89

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-

SUBTOTAL -  
15% OH&P -  
TOTAL -

CUSTOMER APPROVAL AND ACCEPTANCE: The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

**SHEET TOTAL 14,911.93**



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

**TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

PROJECT: WASHWATER TANK SHT No: 2157  
 LOCATION: Sturgeon Point, Derby NY CUSTOMER: DN TANKS DATE(s): 6/5/24  
 ACTIVITY: Excavate UNSUITABLE SOILS & Haul OFF SITE, INSTALL TEMP: \_\_\_\_\_ deg F  
Additional 2" CRUSHER RUN WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST,OT,DT	\$/HR	
<del>Super</del> Michael Allen		Supt			000000	-	-	-
Don Lukas		operator				-	-	-
Pennis Nopper		LABORER				-	-	-
RICK Emke		"				-	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	OWNED EQUIPMENT		TIME ON SITE				OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR	RATE				
2019 CAT 335 Excavator w/3 Buckets				8	-		-	-	
2019 CAT 304 Excavator w/3 Buckets					-		-	-	
2019 CAT 299 SKIDSTEER w/BROOM					-		-	-	
2010 F-250 Superduty 4x4				2	-		-	-	
2022 RAM 5500 Crew 6x4				2	-		-	-	
Magnum Light Tower/Generator					-		-	-	
							SUBTOTAL	-	
							% OH&P	-	
							TOTAL	-	

DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Newson RC70 Roller	Adimar		-
CAT D5 Dozer 2019	UNIVERSAL ENGINE		-
3 TRIAXLE Dump TRUCKS	IRIQUOIS		-
8 Loads of 2" CRUSHER RUN	IRIQUOIS		-
			SUBTOTAL
			% OH&P
			TOTAL

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
						-
						-
						-
						SUBTOTAL
						% OH&P
						TOTAL

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

SHEET TOTAL

AUTHORIZATION (Print/Sign) Mgk ORGANIZATION: \_\_\_\_\_





STC CONSTRUCTION, INC.

PO Box 459, 63 Zoar Valley Road  
Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY      **CUSTOMER:** DN Tanks  
**ACTIVITY:** Haul in 2" crusher run; compact and test; brought site up to 599.75 grade.

**SHT No:** 2159  
**DATE:** 06-06-2024  
**TEMP:** deg F  
**WTHR:** Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT	
		START	END		\$/HR	ST,OT,DT		
Michael Allen	Superintendent			8	122.02	ST	976.16	
Don Lulas	Operator			8	115.18	ST	921.44	
Dennis Nopper	Laborer			8	87.71	ST	701.68	
Rick Emke	Laborer			8	87.71	ST	701.68	
							-	
							-	
							-	
							-	
							-	
							-	
<b>SUBTOTAL</b>								3,300.96
15% OH&P								495.14
<b>TOTAL</b>								3,796.10

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)			1		925.00			925.00
2019 CAT 299D2 Skidsteer w/ broom (E89)			1		676.00			676.00
2010 F-250 Super Duty 4x4 (T10)			1		35.53	2		35.53
2022 Ram 5500 Crew 6x4 (T51)			1		46.35	2		46.35
Magnum Light Tower (E45)			1		36.23			36.23
								-
								-
								-
								-
								-
								-
								-
<b>SUBTOTAL</b>								1,719.11
0% OH&P								-
<b>TOTAL</b>								1,719.11

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
2019 CAT D5 Dozer (8 op hours)	Universal Engine	1389	270.00
Wacker Neuson RC70 Roller (8 op hours)	Admar Supply	BU2071609	162.00
(5) Triaxle Dump Trucks	Iroquois Bar	55049	176.08
(15) loads 2" crusher run	Iroquois Bar	55015	4,290.00
hauling charges for aggregate	Iroquois Bar	55049	5,685.90
			-
			-
			-
			-
			-
			-
			-
			-
<b>SUBTOTAL</b>			10,583.98
15% OH&P			1,587.60
<b>TOTAL</b>			12,171.58

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT	
		START	END				
						-	
						-	
						-	
						-	
						-	
						-	
						-	
						-	
<b>SUBTOTAL</b>						-	
15% OH&P						-	
<b>TOTAL</b>						-	
<b>CUSTOMER APPROVAL AND ACCEPTANCE:</b> The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.						<b>SHEET TOTAL</b>	<b>17,686.79</b>

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

**TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

PROJECT: WASAWATER TANK SHT No: 2159  
 LOCATION: Sturgeon Point Derby NY DATE(s): 6/6/24  
 CUSTOMER: DN TANKS  
 ACTIVITY: Haul IN 2" Crusher Run Compact and TEMP: \_\_\_\_\_ deg F  
TEST Brought Site up to 599.75 GRADE WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME		HRS	RATE		AMOUNT
			START	END		ST,OT,DT	\$/HR	
Michael Allen		Supt			5000	-	-	-
Don Lukas		operator				-	-	-
Dennis Nopper		laborer				-	-	-
RICK EMKE		"				-	-	-
						SUBTOTAL		-
						% OH&P		-
						TOTAL		-

DESCRIPTION	MO	TIME ON SITE			RATE	OPER HRS	RATE	AMOUNT
		WK	DAY	HR				
2019 CAT 335 Excavator w/3 Buckets					-	-	-	
2019 CAT 304 Excavator w/3 Buckets					-	-	-	
2019 CAT 299 Skidsteer w/Broom					-	-	-	
2010 F-250 Superduty 4x4				2	-	-	-	
2022 RAM 5500 Crew 6x4				2	-	-	-	
Magnum Light Tower/Generator					-	-	-	
						SUBTOTAL		-
						% OH&P		-
						TOTAL		-

DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
D5 Cat Dozer 2019	Universal Engine		-
5 Triaxle Dump Trucks	IRIQUOIS		-
15 Loads 2" Crusher Run	IRIQUOIS		-
			SUBTOTAL
			% OH&P
			TOTAL

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
						-
						-
						-
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

SHEET TOTAL

AUTHORIZATION (Print/Sign) [Signature] ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY      **CUSTOMER:** DN Tanks  
**ACTIVITY:** Haul in 2" crusher run, compact and test 4' - overcut for additional undercut.

**SHT No:** 2160  
**DATE:** 06-07-2024  
**TEMP:**                      deg F  
**WTHR:**      Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT	
		START	END		\$ / HR	ST,OT,DT		
Michael Allen	Superintendent			3	122.02	ST	366.06	
Don Lulas	Operator			2	115.18	ST	230.36	
Dennis Nopper	Laborer			2	87.71	ST	175.42	
Rick Emke	Laborer			2	87.71	ST	175.42	
							-	
							-	
							-	
							-	
							-	
<b>SUBTOTAL</b>								947.26
15% OH&P								142.09
<b>TOTAL</b>								1,089.35

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				2	116.00			232.00
2019 CAT 299D2 Skidsteer w/ broom (E89)				2	43.75			87.50
2010 F-250 Super Duty 4x4 (T10)				2	35.53	2		71.06
2022 Ram 5500 Crew 6x4 (T51)				2	46.35	2		92.70
Magnum Light Tower (E45)				2	4.53			9.06
								-
								-
								-
								-
								-
<b>SUBTOTAL</b>								492.32
0% OH&P								-
<b>TOTAL</b>								492.32

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
2019 CAT D5 Dozer (2 op hours)	Universal Engine	1389	270.00
Wacker Neuson RC70 Roller (2 op hours)	Admar Supply	BU2071609	162.00
(2) loads 2" crusher run	Iroquois Bar	55015	572.00
hauling charges for aggregate	Iroquois Bar	55049	758.12
			-
			-
			-
			-
			-
<b>SUBTOTAL</b>			1,762.12
15% OH&P			264.32
<b>TOTAL</b>			2,026.44

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			HRS	INVOICE NO.	AMOUNT
		START	END				
						-	
						-	
						-	
						-	
						-	
<b>SUBTOTAL</b>						-	
15% OH&P						-	
<b>TOTAL</b>						-	

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

<b>15% OH&amp;P</b>	-
<b>TOTAL</b>	-
<b>SHEET TOTAL</b>	<b>3,608.11</b>

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

**TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

PROJECT: WASH WATER TANK SHT No: 2160  
 LOCATION: Sturgeon Point, Dorado NY CUSTOMER: DN TANKS DATE(s): 6/7/24  
 ACTIVITY: Haul in 2" Crusher Run, Compact-Test TEMP: \_\_\_\_\_ deg F  
4' - Overcut for additional undercut WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST, OT, DT	\$ / HR	
Michael Allen		Supt.			3	-	-	-
Don Lubas		operator			2	-	-	-
Dennis Nopper		laborer			2	-	-	-
Rick Emke		"			2	-	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	MO	TIME ON SITE			RATE	OPER HRS	RATE	AMOUNT
		WK	DAY	HR				
2019 CAT 335 Excavator w/3 Buckets					-	-	-	-
2019 CAT 304 Excavator w/3 Buckets					-	-	-	-
2019 CAT 299 Skidsteer + Broom					-	-	-	-
2010 F-250 Superduty 4x4					-	2	-	-
2022 Ram 5500 Crewcab 6x4					-	2	-	-
Magnum Light Tower / Generator					-	-	-	-
							SUBTOTAL	-
							% OH&P	-
							TOTAL	-

DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
2019 CAT D5 Dozer	Universal Engine		-
TRIAxLE Dump TRUCK	TRIQUOIS		-
2 Loads 2" CRUSHER Run	TRIQUOIS		-
			SUBTOTAL
			% OH&P
			TOTAL

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
						-
						-
						-
						SUBTOTAL
						% OH&P
						TOTAL

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

SHEET TOTAL

AUTHORIZATION (Print/Sign) [Signature] ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation  
**LOCATION:** Sturgeon Point, Derby, NY **CUSTOMER:** DN Tanks  
**ACTIVITY:** Install, compact and test 2" crusher run in tank overcut; lifts 5, 6, 7

**SHT No:** 2161  
**DATE:** 06-10-2024  
**TEMP:** deg F  
**WTHR:** Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT
		START	END		\$ / HR	ST,OT,DT	
Michael Allen	Superintendent			4	122.02	ST	488.08
Don Lulas	Operator			3	115.18	ST	345.54
Dennis Nopper	Laborer			3	87.71	ST	263.13
Rick Emke	Laborer			3	87.71	ST	263.13
							-
							-
							-
							-
							-

**SUBTOTAL** 1,359.88  
 15% **OH&P** 203.98  
**TOTAL** 1,563.86

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				3	171.61			514.83
2019 CAT 299D2 Skidsteer w/ broom (E89)				3	101.92			305.76
2010 F-250 Super Duty 4x4 (T10)				3	5.72	2		17.16
2022 Ram 5500 Crew 6x4 (T51)				3	46.38	2		139.14
Magnum Light Tower (E45)				3	4.53			13.59

**SUBTOTAL** 990.48  
 0% **OH&P** -  
**TOTAL** 990.48

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC70 Roller (3 op hours)	Admar Supply	BU2071609	162.00
Triaxle Dump Truck	Iroquois Bar	55049	49.70
(3) loads 2" crusher run	Iroquois Bar	55015	825.11
hauling charges for aggregate	Iroquois Bar	55049	1,093.59
			-
			-
			-

**SUBTOTAL** 2,400.40  
 15% **OH&P** 360.06  
**TOTAL** 2,760.46

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-

**SUBTOTAL** -  
 15% **OH&P** -  
**TOTAL** -

**SHEET TOTAL** 5,314.80

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

**TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

PROJECT: WASH WATER TANK SHT No: 2161  
 LOCATION: STURGEON POINT DERBY NY CUSTOMER: DN TANKS DATE(s): 6/10/24  
 ACTIVITY: INSTALL, COMPACT & TEST 2" CRUSHER RUN TEMP: \_\_\_\_\_ deg F  
IN TANK OVERCUT LIFTS 5,6,7 WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST,OT,DT	\$/HR	
Michael Allen		supr			4	-	-	-
Don Lukas		operator			3	-	-	-
Dennis Nopper		laborer			3	-	-	-
Rick Emke		1			3	-	-	-
						SUBTOTAL		-
						% OH&P		-
						TOTAL		-

DESCRIPTION	OWNED EQUIPMENT		TIME ON SITE				OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR	RATE				
2019 CAT 335 Excavator w/3 Buckets							-	-	
2019 CAT 304 Excavator w/3 Buckets							-	-	
2019 CAT 299 Skidsteer w/B Room							-	-	
2010 F-250 Super Duty 4x4				2			-	-	
2022 RAM 5500 Crew 6x4				2			-	-	
Magnum Light Tower/Generator							-	-	
						SUBTOTAL		-	
						% OH&P		-	
						TOTAL		-	

DESCRIPTION	MATERIAL & RENTED EQUIPMENT		VENDOR / SUPPLIER	INVOICE NO.	AMOUNT	
	MO	WK				
2019 CAT D5 Dozer			Universal Engine		-	
Wacker Neuson RC 70 Roller			ADMAR		-	
IRIQUOIS TRIAXLE					-	
3 Loads 2" CRUSHER RUN					-	
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
						-
						-
						-
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

**SHEET TOTAL**

AUTHORIZATION (Print/Sign) Meg L / G. ORZAN ORGANIZATION: \_\_\_\_\_



**STC CONSTRUCTION, INC.**  
 PO Box 459, 63 Zoar Valley Road  
 Springville, New York 14141

**DAILY TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION**

**PROJECT:** Sturgeon Point WTP Washwater Tank - Undercut Tank Foundation **SHT No:** 2163  
**LOCATION:** Sturgeon Point, Derby, NY **CUSTOMER:** DN Tanks **DATE:** 06-11-2024  
**ACTIVITY:** Install, compact and test in overcut in lift #8 **TEMP:** \_\_\_\_\_ deg F  
**WTHR:** Sun / Clouds / Rain / Snow

LABOR NAME	TRADE	TIME		HRS	RATE		AMOUNT
		START	END		\$ / HR	ST,OT,DT	
Michael Allen	Superintendent			2	122.02	ST	244.04
Don Lulas	Operator			1	115.18	ST	115.18
Dennis Nopper	Laborer			1	87.71	ST	87.71
Rick Emke	Laborer			1	87.71	ST	87.71
							-
							-
							-
							-
							-
<b>SUBTOTAL</b>							534.64
15% OH&P							80.20
<b>TOTAL</b>							<b>614.84</b>

OWNED EQUIPMENT DESCRIPTION	TIME ON SITE				RATE	OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR				
2019 CAT 335FL Excavator w/ 3 buckets (E90)				1	116.00			116.00
2019 CAT 299D2 Skidsteer w/ broom (E89)				1	43.75			43.75
2010 F-250 Super Duty 4x4 (T10)				1	35.53			35.53
2022 Ram 5500 Crew 6x4 (T51)				1	46.35			46.35
Magnum Light Tower (E45)				1	4.53			4.53
								-
								-
								-
								-
								-
<b>SUBTOTAL</b>							246.16	
0% OH&P							-	
<b>TOTAL</b>							<b>246.16</b>	

MATERIAL & RENTED EQUIPMENT DESCRIPTION	VENDOR / SUPPLIER	INVOICE NO.	AMOUNT
Wacker Neuson RC70 Roller (1 op hour)	Admar Supply	BU2071609	162.00
(2) Triaxle Dump Trucks	Iroquois Bar	55049	46.86
(1) load limestone crusher run	Iroquois Bar	55015	286.00
hauling charges for aggregate	Iroquois Bar	55049	379.06
			-
			-
			-
			-
			-
<b>SUBTOTAL</b>			1,143.92
15% OH&P			171.59
<b>TOTAL</b>			<b>1,315.51</b>

SUBCONTRACTORS / SERVICES DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME		HRS	INVOICE NO.	AMOUNT
		START	END			
						-
						-
						-
						-
						-
<b>SUBTOTAL</b>						-

**CUSTOMER APPROVAL AND ACCEPTANCE:** The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

15% OH&P	-
<b>TOTAL</b>	-
<b>SHEET TOTAL</b>	<b>2,176.51</b>

AUTHORIZATION (Print/Sign) \_\_\_\_\_ / \_\_\_\_\_ ORGANIZATION: \_\_\_\_\_



STC CONSTRUCTION, INC.  
 PO Box 459, 63 Zoar Valley Road PH (716) 592-3400  
 Springville, New York 14141 FX (716) 592-4367

TIME & MATERIAL RECORD /  
 EXTRA WORK AUTHORIZATION

PROJECT: Wastewater TANK SHT No: 2163  
 LOCATION: Sturgeon Point, Derby NY CUSTOMER: DN TANKS DATE(s): 6/11/24  
 ACTIVITY: INSTALL, Compact & TEST IN OVERCUT IN LIFT #8 TEMP: \_\_\_\_\_ deg F  
 WTHR: Sun / Clouds / Rain / Snow

NAME	LABOR	TRADE	TIME			RATE		AMOUNT
			START	END	HRS	ST,OT,DT	\$/HR	
Michael Allen		Supt			2	-	-	-
Don Lukas		operator			1	-	-	-
Dennis Nopper		laborer			1	-	-	-
Rick Emke		1			1	-	-	-
						SUBTOTAL		-
						% OH&P		-
						TOTAL		-

DESCRIPTION	OWNED EQUIPMENT		TIME ON SITE				OPER HRS	RATE	AMOUNT
	MO	WK	DAY	HR	RATE				
2019 CAT 335 Excavator w/3 Buckets						-	-	-	
2019 CAT 304 Excavator w/3 Buckets						-	-	-	
2019 CAT 299 SKIDSTEER w/BROOM						-	-	-	
2010 F-250 SuperDuty 4x4						-	-	-	
2022 RAM 5500 Crew 6x4						-	-	-	
Magnum Light Tower / Generator						-	-	-	
						SUBTOTAL		-	
						% OH&P		-	
						TOTAL		-	

DESCRIPTION	MATERIAL & RENTED EQUIPMENT		VENDOR / SUPPLIER	INVOICE NO.	AMOUNT	
	MO	WK				
2019 CAT D5 Dozer			Universal Engine		-	
Wacker Neuson RCTO Roller			Adimar		-	
2 JRIOWAIS TRIAXLE Dump Trucks JRIOWAIS					-	
1 Load limestone CRUSHER Run JRIOWAIS					-	
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

DESCRIPTION (NAMES, EQPT, ETC.)	SUBCONTRACTOR	TIME			INVOICE NO.	AMOUNT
		START	END	HRS		
						-
						-
						-
					SUBTOTAL	-
					% OH&P	-
					TOTAL	-

CUSTOMER APPROVAL AND ACCEPTANCE: The undersigned acknowledges that the work detailed above was ordered by the Customer; that the material, labor, equipment, and subcontractor items listed are correct; and that he/she is duly authorized by the Customer to sign for and approve the work performed.

AUTHORIZATION (Print/Sign) [Signature] / G. McBean ORGANIZATION: \_\_\_\_\_

SHEET TOTAL



## Adjustments for E90 in All Saved Models

### Caterpillar 335F L CR (disc. 2020)

Crawler Mounted Hydraulic Excavators



Size Class:  
**40.5 - 50.4 mt**  
 Weight:  
**N/A**

### Configuration for 335F L CR (disc. 2020)

Horsepower **199.8 hp**

### Blue Book Rates

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs	FHWA Rate**
	Monthly	Weekly	Daily	Hourly	Hourly	Hourly
Published Rates	USD \$15,595.00	USD \$4,365.00	USD \$1,090.00	USD \$165.00	USD \$50.57	USD \$139.18
<b>Adjustments</b>						
Region ( New York: 104%)	USD \$623.80	USD \$174.60	USD \$43.60	USD \$6.60		
Model Year (2019: 100%)	USD \$0.74	USD \$0.21	USD \$0.05	USD \$0.01		
Adjusted Hourly Ownership Cost (100%)						
Hourly Operating Cost (100%)						
<b>Total:</b>	<b>USD \$16,219.54</b>	<b>USD \$4,539.81</b>	<b>USD \$1,133.65</b>	<b>USD \$171.61</b>	<b>USD \$50.57</b>	<b>USD \$142.73</b>

### Non-Active Use Rates

	Hourly
Standby Rate	USD \$56.22
Idling Rate	USD \$107.45

### Rate Element Allocation

Element	Percentage	Value
Depreciation (ownership)	33%	USD \$5,146.35/mo
Overhaul (ownership)	39%	USD \$6,082.05/mo
CFC (ownership)	17%	USD \$2,651.15/mo
Indirect (ownership)	11%	USD \$1,715.45/mo
Fuel (operating) @ USD 4.03	30.24%	USD \$15.29/hr

Revised Date: 2nd quarter 2024


These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.

The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)

## Adjustments for E87 in All Saved Models

### Caterpillar 304E2 CR (disc. 2022)

Crawler Mounted Compact Excavators



Size Class:

3.5 - 4.4 mt

Weight:

N/A

### Configuration for 304E2 CR (disc. 2022)

Horsepower  
Operator Protection

40.2 hp  
ROPS

Operating Weight  
Power Mode

8906 lbs  
Diesel

### Blue Book Rates

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs Hourly USD \$14.23	FHWA Rate** Hourly USD \$29.14
	Monthly	Weekly	Daily	Hourly		
Published Rates	USD \$2,625.00	USD \$735.00	USD \$185.00	USD \$28.00		
<b>Adjustments</b>						
Region ( New York: 103.6%)	USD \$94.50	USD \$26.46	USD \$6.66	USD \$1.01		
Model Year (2019: 99.96%)	(USD \$1.16)	(USD \$0.33)	(USD \$0.08)	(USD \$0.01)		
Adjusted Hourly Ownership Cost (100%)	-	-	-	-		
Hourly Operating Cost (100%)					-	
<b>Total:</b>	<b>USD \$2,718.34</b>	<b>USD \$761.13</b>	<b>USD \$191.58</b>	<b>USD \$29.00</b>	<b>USD \$14.23</b>	<b>USD \$29.68</b>

### Non-Active Use Rates

Standby Rate

Hourly

USD \$10.04

Idling Rate

USD \$21.44

### Rate Element Allocation

Element	Percentage	Value
Depreciation (ownership)	29%	USD \$761.25/mo
Overhaul (ownership)	35%	USD \$918.75/mo
CFC (ownership)	18%	USD \$472.50/mo
Indirect (ownership)	18%	USD \$472.50/mo
Fuel (operating) @ USD 4.03	42.09%	USD \$5.99/hr

Revised Date: 2nd quarter 2024

These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.


The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)

## Adjustments for E89 in All Saved Models

April 23, 2024

### Caterpillar 299D2 (disc. 2019)

Compact Track Loaders

 Size Class:  
**2851 - 3200 lbs**  
 Weight:  
**N/A**


### Configuration for 299D2 (disc. 2019)

Horsepower	<b>95.0 hp</b>	Operator Protection	<b>ROPS/FOPS</b>
Power Mode	<b>Diesel</b>		

### Blue Book Rates

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs Hourly	FHWA Rate** Hourly
	Monthly	Weekly	Daily	Hourly		
Published Rates	USD \$9,310.00	USD \$2,605.00	USD \$650.00	USD \$98.00	USD \$36.46	USD \$89.36
<b>Adjustments</b>						
Region ( New York: 104%)	USD \$372.40	USD \$104.20	USD \$26.00	USD \$3.92		
Model Year (2019: 100%)	-	-	-	-		
Adjusted Hourly Ownership Cost (100%)	-	-	-	-		
Hourly Operating Cost (100%)						
<b>Total:</b>	<b>USD \$9,682.40</b>	<b>USD \$2,709.20</b>	<b>USD \$676.00</b>	<b>USD \$101.92</b>	<b>USD \$36.46</b>	<b>USD \$91.47</b>

### Non-Active Use Rates

	Hourly
Standby Rate	USD \$26.41
Idling Rate	USD \$69.17

### Rate Element Allocation

Element	Percentage	Value
Depreciation (ownership)	23%	USD \$2,141.30/mo
Overhaul (ownership)	52%	USD \$4,841.20/mo
CFC (ownership)	11%	USD \$1,024.10/mo
Indirect (ownership)	14%	USD \$1,303.40/mo
Fuel (operating) @ USD 4.03	38.84%	USD \$14.16/hr

Revised Date: 2nd quarter 2024

These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.

The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)

## Adjustments for T10 in All Saved Models

April 23, 2024

### Ford F-250


On-Highway Light Duty Trucks

Size Class:

300 hp & Over

Weight:

N/A



### Configuration for F-250

Axle Configuration	4.0 X 4.0	Cab Type	Conventional
Horsepower	385.0 hp	Power Mode	Gasoline
Ton Rating	3.0 / 4.0		

### Blue Book Rates

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs Hourly	FHWA Rate** Hourly
	Monthly	Weekly	Daily	Hourly		
Published Rates	USD \$580.00	USD \$165.00	USD \$41.00	USD \$6.00	USD \$29.81	USD \$33.11
<b>Adjustments</b>						
Region ( New York: 102.5%)	USD \$14.50	USD \$4.13	USD \$1.02	USD \$0.15		
Model Year (2010: 92.93%)	(USD \$42.02)	(USD \$11.95)	(USD \$2.97)	(USD \$0.43)		
Adjusted Hourly Ownership Cost (100%)	-	-	-	-		
Hourly Operating Cost (100%)					-	
<b>Total:</b>	<b>USD \$552.48</b>	<b>USD \$157.17</b>	<b>USD \$39.05</b>	<b>USD \$5.72</b>	<b>USD \$29.81</b>	<b>USD \$32.95</b>

### Non-Active Use Rates

	Hourly
Standby Rate	USD \$2.07
Idling Rate	USD \$28.40

### Rate Element Allocation

Element	Percentage	Value
Depreciation (ownership)	35%	USD \$203.00/mo
Overhaul (ownership)	34%	USD \$197.20/mo
CFC (ownership)	13%	USD \$75.40/mo
Indirect (ownership)	18%	USD \$104.40/mo
Fuel (operating) @ USD 3.45	84.74%	USD \$25.26/hr

Revised Date: 2nd quarter 2024

These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.

The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)

## Adjustments for T51 in All Saved Models

April 23, 2024

### Ford F450 4X4 DIESEL (disc. 2018)


Crew Cab Pickups

Size Class:

5

Weight:

N/A



### Configuration for F450 4X4 DIESEL (disc. 2018)

Power Mode	Diesel	Wheelbase	172 Inches
Axle Configuration	4x4	Complete / Incomplete	C
Gross Vehicle Weight	16500 Pounds		

### Blue Book Rates

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs Hourly	FHWA Rate** Hourly
	Monthly	Weekly	Daily	Hourly		
Published Rates	USD \$4,145.00	USD \$1,160.00	USD \$290.00	USD \$44.00	USD \$55.93	USD \$79.48
<b>Adjustments</b>						
Region ( New York: 105.4%)	USD \$223.83	USD \$62.64	USD \$15.66	USD \$2.38		
Model Year (2018: 100%)	-	-	-	-		
Adjusted Hourly Ownership Cost (100%)	-	-	-	-		
Hourly Operating Cost (100%)						
<b>Total:</b>	<b>USD \$4,368.83</b>	<b>USD \$1,222.64</b>	<b>USD \$305.66</b>	<b>USD \$46.38</b>	<b>USD \$55.93</b>	<b>USD \$80.75</b>

### Non-Active Use Rates

Standby Rate	Hourly	USD \$14.15
Idling Rate	Hourly	USD \$63.31

### Rate Element Allocation

Element	Percentage	Value
Depreciation (ownership)	17%	USD \$704.65/mo
Overhaul (ownership)	43%	USD \$1,782.35/mo
CFC (ownership)	15%	USD \$621.75/mo
Indirect (ownership)	25%	USD \$1,036.25/mo
Fuel (operating) @ USD 4.03	68.82%	USD \$38.49/hr

Revised Date: 2nd quarter 2024

These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.

The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)

**Adjustments for E45 in All Saved Models**
**Magnum MLT3060**  
 Portable Light Towers

 Size Class:  
**To 7 kW**  
 Weight:  
**N/A**
**Configuration for MLT3060**

 Power Mode **Diesel**
**Blue Book Rates**

\*\* FHWA Rate is equal to the monthly ownership cost divided by 176 plus the hourly estimated operating cost.

	Ownership Costs				Estimated Operating Costs Hourly	FHWA Rate** Hourly
	Monthly	Weekly	Daily	Hourly		
Published Rates	USD \$565.00	USD \$160.00	USD \$40.00	USD \$6.00	USD \$4.07	USD \$7.28
<b>Adjustments</b>						
Region ( New York: 104.3%)	USD \$24.30	USD \$6.88	USD \$1.72	USD \$0.26		
Model Year (2005: 86.85%)	(USD \$77.50)	(USD \$21.95)	(USD \$5.49)	(USD \$0.82)		
Adjusted Hourly Ownership Cost (100%)	-	-	-	-		
Hourly Operating Cost (100%)					-	
<b>Total:</b>	<b>USD \$511.80</b>	<b>USD \$144.93</b>	<b>USD \$36.23</b>	<b>USD \$5.43</b>	<b>USD \$4.07</b>	<b>USD \$6.98</b>

**Non-Active Use Rates**

	Hourly
Standby Rate	USD \$1.31
Idling Rate	USD \$4.52

**Rate Element Allocation**

Element	Percentage	Value
Depreciation (ownership)	26%	USD \$146.90/mo
Overhaul (ownership)	55%	USD \$310.75/mo
CFC (ownership)	9%	USD \$50.85/mo
Indirect (ownership)	10%	USD \$56.50/mo
Fuel (operating) @ USD 4.03	39.56%	USD \$1.61/hr

Revised Date: 2nd quarter 2024

These are the most accurate rates for the selected Revision Date(s). However, due to more frequent online updates, these rates may not match Rental Rate Blue Book® Print. Visit the Cost Recovery Product Guide on our Help page for more information.

The equipment represented in this report has been exclusively prepared for JASON RICE (jason@stc.build)


REVISED

# Invoice

Universal Engine  
3999 Lake Shore Road  
Blasdell, NY 14219

Date	Invoice #
6/24/2024	1389

<b>Bill To</b>
STC Construction PO BOX 459 Springville NY 14141
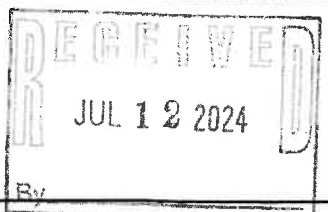
<b>Ship To</b>
Erie County Water

By

Job No.	P.O. No.	Terms	Due Date	Ship Date
			6/24/2024	5/28/2024

Item	Description	Quantity	Rate	Amount
Machine Rental Mobilize OD Load	Rental D5 Dozer 5/28 thru 6/25	1	5,400.00	5,400.00T
	Mobilize OD Load	2	155.00	310.00T
<b>PAYABLES 7/19/24</b>				
VENDOR: UUI009		JOB NO.: 2706.020		
INV. DATE: 6/24/24		JOB CAT: 3		
INV # 1389		G/L #: 41300		
AMT: 6209.63		ENTERED:		
AMT. PD.:		CK. #:		

<b>Subtotal</b>	\$5,710.00
<b>Sales Tax (8.75%)</b>	\$499.63
<b>Total</b>	\$6,209.63
<b>Payments/Credits</b>	\$0.00
<b>Balance Due</b>	\$6,209.63

<b>Phone #</b>
716-481-3298

<b>E-mail</b>
universalengine@aol.com



CONSTRUCTION EQUIPMENT & SUPPLIES


ADMAR - BUFFALO  
1394 Military Rd  
Buffalo, NY 14217  
Phone: (716) 873-8000

RENTAL  
SALES  
SERVICE  
PARTS

# RENTAL CYCLE INVOICE

Invoice Number:	BU2071609
Invoice Date:	31-May-2024
Due Date:	30-Jun-2024
Customer ID:	700884
Order Number:	RO-BU1051486
Salesperson:	Warren Wilkes
Terms:	Net 30 Days
Customer PO:	VERBAL MIKE
Job Name:	Sturgeon Point Water Treatment
Ordered By:	Mike Allen//716-572-1115

**BILL TO: Attention Accounts Payable**  
STC CONSTRUCTION INC  
P.O.BOX 459  
SPRINGVILLE NY 14141

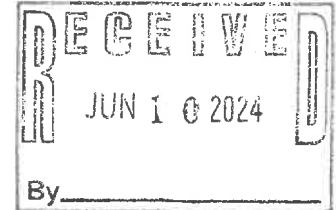

**SHIP TO: Job Site**  
Sturgeon Point Water Treatment  
722 Sturgeon Point Rd  
Derby NY 14047  
Attn: Norris Poleon

ITEM	QTY.	UOM	UNIT PRICE	EXTENDED PRICE				
RENTAL: 66" 8 TON 1 DRUM VIB ROLLER	1.00	EACH	3,230.00	3,230.00				
Equipment Nbr: Serial Nbr	DAY	WEEK	4 WKS	Bill Start Date	Bill End Date	Rent Days	On Rent Date	Meter Usage (hours) :
90627:	495.00	1,320.00	3,230.00	5/15/2024	6/11/2024	28	5/15/2024	Usage: -756.900000
WNCR0801AHAA00162								Start: 756.900000
								End: 0.000000
Make: WACKER Model: WACKER RC70 66" DIRT ROLLER ROPS								
Environmental Fee	1.00	EACH	32.30	32.30				
—SURCHARGE: Fuel Surcharge	1.00	EACH	30.00	30.00				
—DELIVERY: Delivery	1.00	EACH	135.00	135.00				
—PICKUP: Pick Up	1.00	EACH	135.00	135.00				

### PAYABLES

6/28/24

VENDOR: ADMAR	JOB NO.: 2306
INV. DATE: 5/31/24	JOB CAT: 3
INV # BU2071609	GL #: 41300
AMT: 3874.00	ENTERED: 56449
AMT. PD.:	CK. #:

**REMIT TO:**  
ADMAR Construction Equipment & Supplies  
1950 Brighton Henrietta Townline Rd  
Rochester, NY 14623

Subtotal:	3,562.30
Tax Total:	311.70
Invoice Total:	3,874.00
Payment Applied:	0.00
Balance Due:	3,874.00






# INVOICE

Invoice #:	1818
Invoice Date:	06/15/24
Due Date:	07/15/24
Customer No:	2189
Plant Location:	70 Collins Gravel

**Sold To:**

S T C CONSTRUCTION, INC.  
 P.O. BOX 459  
 SPRINGVILLE, NY 14141-0459

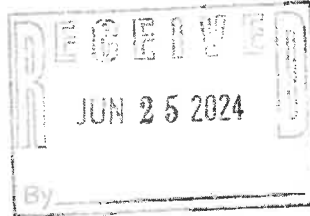

**REMIT TO:**

GERNATT ASPHALT PRODUCTS  
 DEPT 124  
 P.O. BOX 8000  
 BUFFALO, NY 14267  
 PHONE: 716-532-3371

Sale Date	Ticket	Truck	Units	UM	Unit Price	Matl Total	Haul Total	Tax Code	Tax	Total
<b>Job #:</b> 2189-05 2024 STURGEON POINT WWTP										
<b>PO #:</b>										
<b>MATERIAL: TRIAXLE TRUCK RENTAL</b>										
06/3/24	324467	GE16	1.00	HRS	135.00	135.00	0.00	EXEM	0.00	135.00
06/3/24	GE37706	GE62	6.08	HRS	135.00	820.80	0.00	EXEM	0.00	820.80
06/3/24	GE39518	GE35	5.20	HRS	135.00	702.00	0.00	EXEM	0.00	702.00
<b>Total Material: TRIAXLE TRUCK RENTAL</b>			<b>12.28</b>	<b>HRS</b>		<b>1,657.80</b>	<b>0.00</b>		<b>0.00</b>	<b>1,657.80</b>
<b>MATERIAL: SITE TRUCK RENTAL</b>										
06/3/24	324467	GE16	5.25	HRS	155.00	813.75	0.00	EXEM	0.00	813.75
06/3/24	GE37706	GE62	0.75	HRS	155.00	116.25	0.00	EXEM	0.00	116.25
06/3/24	GE39518	GE35	1.30	HRS	155.00	201.50	0.00	EXEM	0.00	201.50
<b>Total Material: SITE TRUCK RENTAL</b>			<b>7.30</b>	<b>HRS</b>		<b>1,131.50</b>	<b>0.00</b>		<b>0.00</b>	<b>1,131.50</b>
<b>Total:</b>						<b>2,789.30</b>	<b>0.00</b>		<b>0.00</b>	<b>2,789.30</b>

**PAYABLES** 7/12/24

VENDOR: GER003	JOB NO.: 2306.020
INV. DATE: 6/15/24	JOB CAT: 1
INV # 1818	G/L #: 4100
AMT: 2789.30	ENTERED:
AMT. PD.:	CK. #:

Pay Terms NET 30

Total: 2,789.30

A FINANCE CHARGE of 1.5% per month (18% per annum) will be charged on invoices not paid within terms.

IROQUOIS BAR CORP.  
 155 Commerce Drive  
 Lackawanna, NY 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



# IROQUOIS

CONSTRUCTION SERVICES

INVOICE NO  
 55015



STC Construction, Inc.  
 P.O. Box 459  
 Springville, NY 14141-0459

SITE STC Construction, Inc.  
 Sturgeon Point  
 Water Tank Replacement

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/17/2024	Net 30	7/17/2024	27524		1

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/5/2024	179.16 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$2,329.08 *
6/6/2024	394.74 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$5,131.62 *
6/7/2024	66.39 ✓	Material Sales #1 STONE NESL WEHRLE	\$25.15	\$1,669.71 *
6/7/2024	377.25 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$4,904.25 *
6/10/2024	438.53 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$5,700.89 *
6/11/2024	177.83 ✓	Material Sales 1" CRUSHER RUN NESL WEHRLE	\$19.95	\$3,541.72 *
6/11/2024	68.81 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$868.53 *
6/14/2024	251.76 ✓	Material Sales 2" CRUSHER RUN NESL WEHRLE	\$13.00	\$3,272.88 *

\*\*Failure to object to or dispute the prices, services or materials listed on any invoice issued by Iroquois Bar Corp. within 30 days of your receipt of same shall constitute your acceptance of same.

**TOTAL AMOUNT \$27,418.68**

\* means item is non-taxable

Tickets attached to  
 inv # 55171, 55049, 55198,  
 55216

CERTIFIED MBE, DBE  
[www.IroquoisBar.com](http://www.IroquoisBar.com)

PAYABLES 7/26/24

VENDOR: IRO 002	JOB NO: 2306.020
INV. DATE: 6/17/24	JOB CAT: 1
INV # 55015	GL #: 4110
AMT: 27,418.68	ENTERED:
AMT. PD.:	CK. #:

6/11/2024

46.65

Truck 040  
Ticket#100647



# IROQUOIS

INVOICE NO  
55049

**IROQUOIS BAR CORP.**  
155 Commerce Drive  
Lackawanna, NY 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313

CONSTRUCTION SERVICES  
www.IroquoisBar.com

STC Construction, Inc.  
P.O. Box 459  
Springville, NY 14141-0459

SITE STC Construction, Inc.  
Sturgeon Point  
Water Tank Replacement

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/25/2024	Net 30	7/25/2024	27537		5

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/11/2024	0.75	Truck 040 Hourly Ticket#100647 Hourly: 9:54-10:45 am	\$142.00	\$106.50 *

155 Commerce Drive  
**\*\*Failure to object to or dispute the prices, services or materials listed on any invoice issued by Iroquois Bar Corp. within 30 days of your receipt of same shall constitute your acceptance of same.**

**TOTAL AMOUNT \$29,274.21**

\* means item is non-taxable

STC Construction, Inc.  
P.O. Box 459  
Springville, NY 14141-0459

STC Construction, Inc.  
Sturgeon Point **PAYABLES** 7/26/24

VENDOR: IRO-00-2	JOB NO: 2306070
INV. DATE: 6/25/24	JOB CAT: 1
INV # 55049	GL#: 10000000
AMT: 29,274.21	ENTERED: 7/26/24
AMT. PD.:	CK. #:

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE
STC	6/25/2024	Net 30	7/25/2024

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/11/2024	0.75	Truck 040 Hourly Ticket#100647 Hourly: 9:54-10:45 am	\$142.00	\$106.50

Failure to object to or dispute the prices, services or materials listed on any invoice issued by Iroquois Bar Corp. within 30 days of your receipt of same shall constitute your acceptance of same

**TOTAL AMOUNT \$29,274.21**

\* means item is non-taxable

**CERTIFIED MBE, DBE**  
[www.IroquoisBar.com](http://www.IroquoisBar.com)


INVOICE NO  
55049



# IROQUOIS

CONSTRUCTION SERVICES

IROQUOIS BAR CORP.  
155 Commerce Drive  
Lackawanna, NY 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313

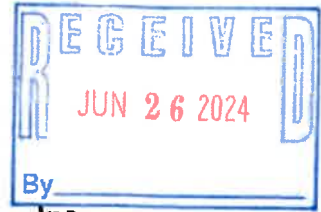

STC Construction, Inc.  
P.O. Box 459  
Springville, NY 14141-0459

SITE STC Construction, Inc.  
Sturgeon Point  
Water Tank Replacement

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/25/2024	Net 30	7/25/2024	27537		1

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/11/2024	45.42 ✓	Truck 043 Ticket#101930 Aggregate Delivery NESL Wehrle 1" CR	\$17.23	\$782.59 *
6/11/2024	6.55 ✓	Truck 043 Hourly Ticket#101930 Wait time	\$142.00	\$46.86 *
6/7/2024	92.16 ✓	Truck 37 Ticket #120449 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,587.92 *
6/13/2024	2.25 ✓	Truck 046 Hourly Ticket#104910	\$142.00	\$319.50 *
6/4/2024	8.75 ✓	Truck 34 Hourly Ticket#98233	\$142.00	\$1,242.50 *
6/5/2024	4.00 ✓	Truck 34 Hourly Ticket#98234 Aggregate Delivery NESL Wehrle	\$142.00	\$568.00 *
6/5/2024	0.50 ✓	Truck 34 Hourly Ticket#98234 Travel	\$142.00	\$71.00 *
6/5/2024	69.73 ✓	Truck 34 Ticket#98234 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,201.45 *
6/5/2024	5.00 ✓	Truck 019 Hourly Ticket #103003 Hourly # 6:00-#1:05 am	\$142.00	\$710.00 *
6/5/2024	0.50 ✓	Truck 019 Hourly Ticket #103003 NESL Wehrle	\$142.00	\$71.00 *

CERTIFIED MBE, DBE  
www.IroquoisBar.com

6/4/2024	8.75	Truck 34 Hourly Ticket#98233	\$142.00	\$1,242.50 *
6/5/2024	3.00	Truck 34 Hourly Ticket#98234	\$142.00	\$426.00 *

5/1/2024 5.60  
6/5/2024 0.50



Truck 013  
Hourly Ticket #103003  
Ticket #103003

INVOICE NO  
55049

# IROQUOIS

## CONSTRUCTION SERVICES

**IROQUOIS BAR CORP.**  
155 Commerce Drive  
Lackawanna, NY 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313

STC Construction, Inc.  
P.O. Box 459  
Springville, NY 14141-0459

SITE **STC Construction, Inc.**  
**Sturgeon Point**  
**Water Tank Replacement**

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/25/2024	Net 30	7/25/2024	27537		2

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/5/2024	42.80 ✓	Truck 013 Ticket #103003 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$737.44 *
6/6/2024	67.26 ✓	Truck 013 Ticket #103004 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,158.89 *
6/6/2024	0.25 ✓	Truck 013 Hourly Ticket #103004 Wait time	\$142.00	\$35.50 *
6/7/2024	87.84 ✓	Truck 013 Ticket #103006 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,513.48 *
6/6/2024	87.27 ✓	Truck 31 Ticket #109280 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,503.66 *
6/6/2024	0.27 ✓	Truck 31 Hourly Ticket #109280 Wait time	\$142.00	\$38.34 *
6/7/2024	89.44 ✓	Truck 31 Ticket #109281 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,541.05 *
6/10/2024	63.47 ✓	Truck 044 Ticket #104677 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,093.59 *

**CERTIFIED MBE, DBE**  
[www.IroquoisBar.com](http://www.IroquoisBar.com)



# IROQUOIS

## CONSTRUCTION SERVICES

INVOICE NO  
55049

**IROQUOIS BAR CORP.**  
155 Commerce Drive  
Lackawanna, NY 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313

STC Construction, Inc.  
P.O. Box 459  
Springville, NY 14141-0459

SITE **STC Construction, Inc.**  
**Sturgeon Point**  
**Water Tank Replacement**

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/25/2024	Net 30	7/25/2024	27537		3

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/10/2024	3.35	Delivery NESL Wehrle Truck 044 Hourly Ticket#104877 Wait time	\$142.00	\$495.70 *
6/4/2024	5.50	Truck 053 Hourly Ticket#108594	\$142.00	\$781.00 *
6/6/2024	66.48	Truck 30 Ticket #105759 Aggregate Delivery NESL Wehrle 2" CR	\$17.23	\$1,145.45 *
6/6/2024	0.12	Truck 30 Hourly Ticket #105759 Wait time	\$142.00	\$17.04 *
6/3/2024	4.75	Truck 058 Hourly Ticket#100847	\$142.00	\$674.50 *
6/6/2024	187.46	Truck 011 Ticket #103133 Aggregate Delivery NESL Wehrle 2"	\$17.23	\$1,506.94 *
6/8/2024	0.33	Truck 011 Hourly Ticket #103133 Wait time	\$142.00	\$46.86 *
6/7/2024	87.28	Truck 053 Ticket #103134 Aggregate Delivery NESL Wehrle NY # 1 -	\$17.23	\$1,503.83 *
6/7/2024	0.08	Truck 053 Hourly Ticket#103134 Wait time	\$142.00	\$11.36 *
6/4/2024	9.00	Truck 055 Hourly Ticket#101977	\$142.00	\$1,278.00 *

**CERTIFIED MBE, DBE**  
[www.IroquoisBar.com](http://www.IroquoisBar.com)

**IROQUOIS BAR CORP.**  
 155 Commerce Drive  
 Lackawanna, NY 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



# IROQUOIS

## CONSTRUCTION SERVICES

**INVOICE NO**  
**55049**

**STC Construction, Inc.**  
 P.O. Box 459  
 Springville, NY 14141-0459

**SITE** **STC Construction, Inc.**  
**Sturgeon Point**  
**Water Tank Replacement**

ACCOUNT NO	INVOICE DATE	TERMS	DUE DATE	ORDER	PO NUMBER	PAGE
STC	6/25/2024	Net 30	7/25/2024	27537		4

SERVICE DATE	QUANTITY	DESCRIPTION	UNIT PRICE	EXTENDED
6/12/2024	8.00	Truck 014 Hourly Ticket #101306	\$142.00	\$1,136.00 *
6/4/2024	2.75	Truck 043 Hourly Ticket #101374	\$142.00	\$390.50 *
6/5/2024	4.25	Truck 014 Hourly Ticket #101375 Hourly: 6:00-10:10 am	\$142.00	\$603.50 *
6/5/2024	0.50	Truck 014 Hourly Ticket #101375 Wait time	\$142.00	\$71.00 *
6/5/2024	66.64	Truck 014 Ticket #101375 Aggregate Delivery NESL Wehrle <i>2" CR</i>	\$17.23	\$1,148.21 *
6/6/2024	64.15	Truck 016 Ticket #102951 Aggregate Delivery NESL Wehrle <i>2" CR</i>	\$17.23	\$1,105.30 *
6/6/2024	0.27	Truck 016 Hourly Ticket #102951 Wait time	\$142.00	\$38.34 *
6/7/2024	86.92	Truck 016 Ticket #102953 Aggregate Delivery NESL Wehrle <i>2" CR</i>	\$17.23	\$1,497.63 *
6/12/2024	8.00	Truck 016 Hourly Ticket #102959	\$142.00	\$1,136.00 *
6/17/2024	46.65	Truck 040 Ticket #100647 Aggregate Delivery NESL Wehrle <i>2" CR</i>	\$17.23	\$803.78 *

**CERTIFIED MBE, DBE**

[www.IroquoisBar.com](http://www.IroquoisBar.com)

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: 95,971  
 Start: 95,849

Gallons: \_\_\_\_\_

No. 101,930-1 Date: 6.11.24

Customer: STC

Job: \_\_\_\_\_

Truck No. #43 Driver AL Davis RN

LOAD LOCATION <u>Wehrle</u>	Job Start <u>7:00 AM</u>
DUMP LOCATION <u>Sturgeon point</u>	Job Finish <u>10:45 AM</u>
MATERIAL <u>1"cr / 2"cr</u>	Travel Time <u>1</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>4 1/4 hrs (9.5)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	<u>50256217</u>	<u>23.88</u>	<u>8:05 AM - 8:10 AM</u>	<u>7:00 AM - 7:10 AM</u>
2	<u>50256280</u>	<u>21.54</u>	<u>10:10 AM - 10:25 AM</u>	<u>9:05 AM - 9:25 AM</u>
3			<u>10:45 AM</u>	
4				
5	<u>Wehrle</u>	<u>1542 T</u>		
6		<u>.33 WT</u>		
7				
8				
9				
10				
11				
12				
13				
14				
15				

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB





# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

1.

PLANT INFORMATION - 54230100 - WEHRLA AGGREGATES (716) 826-7310

ORDER NO. 1000380885	TICKET NUMBER 50256217	SCALE 2	AUTO/MANUAL W	DATE 06/11/2024	TIME 7:07 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Tank Replacement		
SHIP TO: Sturgeon Point Water Tank Replacement			QUOTE: STATE NY ZONE:		
PRODUCT ID 280284	PRODUCT DESCRIPTION STONE, 1" CRUSHER RUN				
JOB NAME / LOCATION: 2023 Sturgeon Point Water Tank Replacement					Item
JOB REQUIRED NUMBERS COUNTY: ERIE 2023 Sturgeon Point Water Tank Replacement					
TAG NO.	AXLES 0	TRUCK BIB043	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 79,980	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 76,020	38.01 Ton	GROSS	ORDERED 0.00	MATERIAL	
28,260	14.13 Ton	TARE	TODAY 90.18	LOADS 4	HAUL
47,760	23.88 Ton	NET	TODATE 90.18	LOADS 4	ADD'L CHARGES
23.88		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50256217		PICKUP	

ORIGINAL - CUSTOMER




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

2.

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000380865	TICKET NUMBER 50256280	SCALE 1	AUTO/MANUAL W	DATE 06/11/2024	TIME 9:21 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Tank Replacement		
SHIP TO: Sturgeon Point Water Tank Replacement			QUOTE: STATE NY ZONE:		
PRODUCT ID 280284	PRODUCT DESCRIPTION STONE, 1" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Tank Replacement					Item
JOB REQUIRED NUMBERS COUNTY: ERIE 2023 Sturgeon Point Water Tank Replacement					
TAG NO.	AXLES 0	TRUCK BIB043	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 79,980		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 71,340	35.67 Ton	GROSS	ORDERED 0.00		MATERIAL
28,260	14.13 Ton	TARE	TODAY 155.29	LOADS 7	HAUL
43,080	21.54 Ton	NET	TODATE 155.29	LOADS 7	ADD'L CHARGES
21.64		Ton	ACCUMULATED CASH SALE		TAX
WEIGHED BY 14497				TOTAL THIS LOAD ➤	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X					
Truck Desc: iroquois bar					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50256280		PICKUP	

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.  
Dba Oneida Trucking**

155 Commerce Drive  
Lackawanna, New York 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 120449 | Date: 6/7

Customer: S.T.C.

Job: waste water treatment plant

Truck No. 37 Driver Antwan

LOAD LOCATION	<u>Nest wehrle</u>	Job Start	<u>630</u>
DUMP LOCATION	<u>waste water treatment plant at sturgeon point</u>	Job Finish	<u>230</u>
MATERIAL	<u>2" crusher</u>	Travel Time	<u>1 hr</u>
REMARKS		<input type="checkbox"/> Lunch	<input checked="" type="checkbox"/> No Lunch
		Total	<u>9</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT	
			IN - OUT	IN - OUT	IN - OUT	IN - OUT
1	5516	24.16	630 - 705		755 - 810	
2	5630	22.28	900 - 915		1005 - 1015	
3	5730	23.73	1105 - 1115		1205 - 1215	
4	5822	21.99	105 - 125		225 - 230	
5			-		-	
6			-		-	
7	<u>wehrle</u>	<u>92.161</u>	-		-	
8			-		-	
9			-		-	
10			-		-	
11			-		-	
12			-		-	
13			-		-	
14			-		-	
15			-		-	

Driver Signature: \_\_\_\_\_

R. Emke  
OUR RESPONSIBILITY ENDS AT THE CURB  
White = IROQUOIS • Yellow = JOB




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd

Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255516	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 7:01 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB037	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 76,980		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 76,040	36.02 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,720	13.86 Ton	TARE	TODAY 68.40	LOADS 3	HAUL
48,320	24.16 Ton	NET	TODATE 4,065.52	LOADS 182	ADD'L CHARGES
24.16		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY TARIFF WILL BE APPLIED. ALL APPLICABLE TARIFFS DATE 06/07/2024
X Truck Desc: IROQUOIS					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> < <a href="http://www.nesi.com">http://www.nesi.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255516		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255830	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 9:10 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB037	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 76,980		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 72,280	36.14 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,720	13.86 Ton	TARE	TODAY 179.02	LOADS 8	HAUL
44,560	22.28 Ton	NET	TODATE 4,176.14	LOADS 187	ADD'L CHARGES
22.28		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					IF SERVICE CHARGES NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW WILL BE PAID TO ALL AMOUNTS COVERED BY PAST DUES
X Truck Desc: IROQUOIS					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> , <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100	Ticket #: 50255830	PICKUP			

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255730	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 11:12 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB037	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 76,980		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 75,180	37.59 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,720	13.86 Ton	TARE	TODAY 245.16	LOADS 11	HAUL
47,460	23.73 Ton	NET	TODATE 4,242.28	LOADS 190	ADD'L CHARGES
23.73		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14487					TOTAL THIS LOAD
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					ALL RIGHTS RESERVED
X					
Truck Desc: IROQUOIS					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (inhalation). May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).</b>  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</b></p>					
Plant #: 54230100		Ticket #: 50255730		PICKUP	

ORIGINAL - CUSTOMER




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255822	SCALE 2	AUTO/MANUAL W	DATE 06/07/2024	TIME 1:13 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB037	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 76,980	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,700	35.85 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,720	13.86 Ton	TARE	TODAY 334.23	LOADS 15	HAUL
43,980	21.99 Ton	NET	TODATE 4,331.35	LOADS 194	ADD'L CHARGES
21.99		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X					
Truck Desc: IROQUOIS					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255822		PICKUP	

ORIGINAL - CUSTOMER

**Iroquois Bar Corp.**  
**DbA Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_  
 Gallons: \_\_\_\_\_

No. 104,910 | Date: 6-13-24

Customer: STC  
 Job: Sturgeon Point  
 Truck No. 046 Driver Bladen Armstrong

LOAD LOCATION <u>Sturgeon Point</u>	Job Start <u>1:18</u>
DUMP LOCATION <u>onsite</u>	Job Finish <u>2:30</u>
MATERIAL <u>Dirt</u>	Travel Time <u>160</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>2.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT
			IN - OUT	IN - OUT	
1	<u>on-site</u>	<u>1st Load</u>	<u>1:18</u>	<u>2:30</u>	---
2		<u>2nd Load</u>	---	---	---
3		<u>3rd Load</u>	---	---	---
4		<u>4th Load</u>	---	---	---
5		<u>5th Load</u>	---	---	---
6			---	---	---
7			---	---	---
8			---	---	---
9			---	---	---
10			---	---	---
11			---	---	---
12			---	---	---
13			---	---	---
14			---	---	---
15			---	---	---

*Mike Allen*

Customer Signature: \_\_\_\_\_  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



**Iroquois Bar Corp.**  
**Db a Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: 266 983  
 Start: 266 762

Gallons: 45.37

No. 98,233 | Date: 6-4-24

Customer: S.T.C  
 Job: # 24289 STURGEON POINT  
 Truck No. 34 Driver Dale Naggo

LOAD LOCATION <u>STURGEON POINT ANGOIA NY</u>	Job Start <u>930</u>
DUMP LOCATION <u>FARNHAM NY</u>	Job Finish <u>315</u>
MATERIAL <u>DIRT</u>	Travel Time <u>1</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(8.75)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT	
			IN	OUT	IN	OUT
1	1		755	800	730	740
2	1		840	845	820	825
3	1		925	930	905	910
4	1		1010	1015	950	955
5	1		1055	1100	1030	1040
6	1		1145	1150	1115	1130
7	1		1235	1240	1210	1215
8	1		130	135	1066	105
9	1		210	215	140	145
10	1		310	315	230	240
11			-	-	-	-
12			-	-	-	-
13			-	-	-	-
14			-	-	-	-
15			-	-	-	-

Customer Signature: Rick Emke  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**Iroquois Bar Corp.**  
**Dba Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: 267314  
 Start: 266983  
 Gallons: 54  
 No. 98,234 | Date: 6-5-24

Customer: S.T.C  
 Job: # 24289 STURGEON POINT WASTE WATER  
 Truck No. 34 Driver Dale Naggo

LOAD LOCATION: <u>STURGEON POINT DERBY NY</u>	Job Start: <u>600</u>
DUMP LOCATION: <u>FARNHAM NY</u>	Job Finish: <u>305</u>
MATERIAL: <u>DIRT</u>	Travel Time: <u>1</u>
REMARKS:	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total: <u>10</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	ON site	1	-	600-610
2		1	640-645	615-620
3		1	725-730	705-710
4		1	810-815	750-755
5		1	900-905	835-840
6	50254845	2265	1100-1105	955-910
7	50254943	2234	1055-1000	1155-1205
8	50254035	2473	300-305	150-210
9			-	-
10	Hourly	6:00-9:55 = 4		
11	Travel	5		
12	Vehicle	69.737		
13				
14				
15				

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227


Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000400985	TICKET NUMBER 50254845	SCALE 1	AUTOMANUAL W	DATE 06/05/2024	TIME 10:03 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: strugeon point stc		
SHIP TO:			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2024 SPECIAL CONTRACTOR SEASONAL- 23/21				Item	
JOB REQUIRED NUMBERS COUNTY: ERIE 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					
TAG NO. 66997MH	AXLES 0	TRUCK BIB034	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,900	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,780	36.39 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,480	13.74 Ton	TARE	TODAY 22.65	LOADS 1	HAUL
45,300	22.65 Ton	NET	TODATE 85.82	LOADS 3	ADD'L CHARGES
22.65		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>A SERVICE CHARGE WILL BE APPLIED TO ALL ACCOUNTS OVERDUE TO PAYABLE TO ALL ACCOUNTS OVERDUE TO PAYABLE TO ALL ACCOUNTS OVERDUE TO PAYABLE</small>
X					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100 Ticket #: 50254845 PICKUP					

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000400965	TICKET NUMBER 50254943	SCALE 2	AUTOMANUAL W	DATE 06/05/2024	TIME 12:02 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: strugeon point stc		
SHIP TO:			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					Item
JOB REQUIRED NUMBERS COUNTY: ERIE 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					
TAG NO. 66997MH	AXLES 0	TRUCK BIB034	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,900	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,160	36.08 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,480	13.74 Ton	TARE	TODAY 65.94	LOADS 3	HAUL
44,680	22.34 Ton	NET	TODATE 109.11	LOADS 5	ADD'L CHARGES
22.34		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>THIS RECEIPT IS NOT VALID UNLESS IT IS SIGNED BY THE DRIVER AND THE TRUCK IS FULLY LOADED WITHIN THE TIME FRAME SPECIFIED ON THE RECEIPT. THIS RECEIPT IS VOID IF THE TRUCK IS NOT FULLY LOADED WITHIN THE TIME FRAME SPECIFIED ON THE RECEIPT.</small>
<b>X</b>					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50254943		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000400965	TICKET NUMBER 50255035	SCALE 1	AUTO/MANUAL W	DATE 06/05/2024	TIME 1:57 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: strugeon point stc		
SHIP TO:			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2024 SPECIAL CONTRACTOR SEASONAL- 23/21				Item	
JOB REQUIRED NUMBERS COUNTY: ERIE 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					
TAG NO. 66997MH	AXLES 0	TRUCK BIB034	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,900	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 76,940	38.47 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,480	13.74 Ton	TARE	TODAY 112.52	LOADS 5	HAUL
49,460	24.73 Ton	NET	TODATE 155.69	LOADS 7	ADD'L CHARGES
24.73		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEBL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT FORWARDED THE MAXIMUM ALLOWABLE BY LAW WILL BE APPLIED TO ALL ACCOUNTS COVERED 30 DAYS PAST DUE</small>
X					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> or by calling (814) 766-2211.					
Plant #: 54230100 Ticket #: 50255035 PICKUP					

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_

No. 103,003 | Date: 6/5/24  
 Gallons: \_\_\_\_\_  
 Customer: JTC  
 Job: Sturgeon Point - 24289  
 Truck No. 13 Driver Dave G. Ambrose

LOAD LOCATION Sturgeon Point Job Start 6:00 AM  
 DUMP LOCATION Fire Load on Sight Job Finish 2:20 AM 2:15  
 MATERIAL Dirt Travel Time + 1 Hr.  
 REMARKS Del. To 795 Farnham  Lunch  No Lunch  
Grant Total (9.25)

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT
			IN - OUT	IN - OUT	
1	<del>111</del>	Dirt	6:00		10:40
2	2 Crashes	Run			
3	50254897	20.95	12:05-12:20	11:05-11:18	
4	56255062	21.85	2:07-2:15	1:10-1:25	
5					
6	Hourly	6.15 - 11.05 = 5			
7	Travel	1.5			
8	Wehrle	47.80T			
9					
10					
11					
12					
13					
14					
15					

Customer Signature: \_\_\_\_\_  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000400965	TICKET NUMBER 50255002	SCALE 1	AUTO/MANUAL W	DATE 06/05/2024	TIME 1:23 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: strugeon point stc	
SHIP TO:				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					Item
JOB REQUIRED NUMBERS COUNTY: ERIE 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 70,720	35.36 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 87.79	LOADS 4	HAUL
43,700	21.85 Ton	NET	TODATE 130.96	LOADS 6	ADD'L CHARGES
21.85		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>ALL SERVICES SUBJECT TO CREDITABLE MATERIALS, LOADS, ETC. ARE SUBJECT TO THEir RESPECTIVE CONTRACTS &amp; PARTS</small>
X					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100                      Ticket #: 50255002                      PICKUP					

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000400985	TICKET NUMBER 50254897	SCALE 1	AUTO/MANUAL W	DATE 06/05/2024	TIME 11:13 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Leckawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: strugeon point stc		
SHIP TO:			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2024 SPECIAL CONTRACTOR SEASONAL- 23/21				Item	
JOB REQUIRED NUMBERS COUNTY: ERIE 2024 SPECIAL CONTRACTOR SEASONAL- 23/21					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 68,920	34.46 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 43.60	LOADS 2	HAUL
41,900	20.95 Ton	NET	TODATE 86.77	LOADS 4	ADD'L CHARGES
20.95		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED THE TOTAL SERVICE CHARGE PER MONTHLY FEE. CALL CUSTOMER SERVICE AT 716-826-1342.</small>
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100 Ticket #: 50254897 PICKUP					

HAULER

Void - Customer Do Not Accept



**Iroquois Bar Corp.**  
**Oneida Trucking**

155 Commerce Drive  
 Ackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 103,004 | Date: 6/6/24

Customer: STC

Job: Sturgeon Point (Waint Water Treat.)

Truck No. \_\_\_\_\_ Driver Dave Giambone

LOAD LOCATION <u>NESL</u>	Job Start <u>6:30</u>
DUMP LOCATION <u>Sturgeon Point</u>	Job Finish <u>12:45</u>
MATERIAL <u>2" Crusher Run</u>	Travel Time <u>1</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(7.25)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50255110	22.93	7:45-7:55	6:25-6:53
2	50255230	22.77 <sup>B</sup>	10:10-10:40	8:52-9:15
3	50255346	21.56	12:35-12:45	11:25-11:45
4			---	---
5			---	---
6	<u>Wentle</u>	<u>107.26T</u>	---	---
7		<u>.25 WT</u>	---	---
8			---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: \_\_\_\_\_  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255110	SCALE 1	AUTOMANUAL W	DATE 06/06/2024	TIME 6:47 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,880	36.44 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 22.93	LOADS 1	HAUL
45,860	22.93 Ton	NET	TODATE 3,625.33	LOADS 162	ADD'L CHARGES
22.93		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>           A SERVICE CHARGE NOT TO EXCEED THE            DISBURSED AMOUNT BY 15% WILL BE APPLIED            TO ALL ACCOUNTS OVER 30 DAYS PAST DUE.         </small>
<b>X</b> Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation). May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). Prevention: Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. Response: If exposed or concerned, get medical advice/attention. Handling and Storage: Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. Disposal: Dispose of contents/container in accordance with all local, regional, national and international regulations. Read the Safety Data Sheet (SDS) before handling this product to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</b>					
Plant #: 54230100		Ticket #: 50255110		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255230	SCALE 1	AUTOMANUAL W	DATE 06/06/2024	TIME 9:11 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,560	36.28 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 133.65	LOADS 6	HAUL
45,540	22.77 Ton	NET	TODATE 3,736.05	LOADS 167	ADD'L CHARGES
22.77		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255230		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255346	SCALE 2	AUTO/MANUAL W	DATE 06/06/2024	TIME 11:40 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 70,140	35.07 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 241.29	LOADS 11	HAUL
43,120	21.56 Ton	NET	TODATE 3,843.69	LOADS 172	ADD'L CHARGES
21.56		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>A SERVICE CHARGE NOT TO EXCEED THE MAXIMUM CHARGE BY LAW WILL BE APPLIED TO ALL AMOUNTS OVER 30 DAYS PAST DUE</small>
<input checked="" type="checkbox"/>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255346		PICKUP	

HAULER

Void - Customer Do Not Accept

**Iroquois Bar-Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-6313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 103,006 | Date: 6/7/24

Customer: STC - Sturgeon Point

Job: Water Treatment PLANT.

Truck No. 13 Driver Dave Giambone

LOAD LOCATION	<u>NEEL Whole on</u>	Job Start	<u>6:30</u>
DUMP LOCATION	<u>Water Treatment PLANT Sturgeon Pt</u>	Job Finish	<u>2:10</u>
MATERIAL	<u>2" Crusher</u>	Travel Time	<u>1</u>
REMARKS		<input type="checkbox"/> Lunch	<input checked="" type="checkbox"/> No Lunch
		Total	<u>8.75</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50255504	22.74	7:45-7:53	6:27-6:57
2	50255608	22.06	9:45-10:00	8:40-8:55
3	50255719	20.94	11:52-12:05	10:50-11:05
4	50255815	22.10	2:00-2:10	12:58-1:12
5			—	—
6			—	—
7	<u>Wenre</u>	<u>87.84 T</u>	—	—
8			—	—
9			—	—
10			—	—
11			—	—
12			—	—
13			—	—
14			—	—
15			—	—

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255504	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 6:52 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14216-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,500	36.25 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 22.74	LOADS 1	HAUL
45,480	22.74 Ton	NET	TODATE 4,019.86	LOADS 180	ADD'L CHARGES
22.74		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD ➔
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF A SERVICE CHARGE IS TO BE DEDUCTED FROM ALL DUES BY LAW SET FORTH IN THE LOCAL AND STATE STATUTES AND REGULATIONS.</small>
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255504		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd

Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255608	SCALE 2	AUTOMANUAL W	DATE 06/07/2024	TIME 8:49 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82406 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,140	35.57 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 111.37	LOADS 5	HAUL
44,120	22.06 Ton	NET	TODATE 4,108.49	LOADS 184	ADD'L CHARGES
22.06		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW WILL BE APPLIED TO ALL AMOUNTS OVER 90 DAYS PAST DUE</small>
<b>X</b> Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255608		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255719	SCALE 2	AUTOMANUAL W	DATE 06/07/2024	TIME 11:00 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 68,900	34.45 Ton	GROSS	ORDERED 500.00		MATERIAL
27,020	13.51 Ton	TARE	TODAY 198.96	LOADS 9	HAUL
41,880	20.94 Ton	NET	TODATE 4,197.08	LOADS 188	ADD'L CHARGES
20.94		Ton	ACCUMULATED CASH SALE		TAX
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW <b>X</b>					<small>IF A DRIVER'S SIGNATURE IS NOT RECEIVED THE COMPANY WILL BE RESPONSIBLE FOR ALL DAMAGES TO THE TRUCK AND EQUIPMENT</small>
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255719		PICKUP	

HAULER

Void - Customer Do Not Accept





# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255815	SCALE 2	AUTO/MANUAL W	DATE 06/07/2024	TIME 1:07 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 38794JY	AXLES 3	TRUCK BIB013	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,220	35.61 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,020	13.51 Ton	TARE	TODAY 290.87	LOADS 13	HAUL
44,200	22.10 Ton	NET	TODATE 4,287.79	LOADS 192	ADD'L CHARGES
22.10		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/>
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 765-2211.</p>					
Plant #: 54230100	Ticket #: 50255815	PICKUP			

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.  
Dba Oneida Trucking**

155 Commerce Drive  
Lackawanna, New York 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS - TRUCKING CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
Start: \_\_\_\_\_  
Gallons: \_\_\_\_\_

No. 109,280 | Date: 8-6-24

Customer: S.T.C  
Job: WASTE WATER TREATMENT STUACON PARAT  
Truck No. 31 Driver DEONTA

LOAD LOCATION <u>WEHLE</u>	Job Start <u>6:38</u>
DUMP LOCATION <u>Waste water treatment</u>	Job Finish <u>3:15</u>
MATERIAL <u>2 in.</u>	Travel Time <u>1 HR</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(9.75)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50255132	23.18	8:07 - 8:20	6:30 - 7:12
2	50255257	21.07 <sup>1/4</sup>	10:36 - 11:05	9:25 - 9:48
3	50255365	21.21	12:55 - 1:08	11:51 - 12:05
4	50255445	21.81	3:05 - 3:15	1:57 - 2:13
5			---	---
6			---	---
7	<u>Wehle</u>	<u>81.21 T</u>	---	---
8		<u>21.11 T</u>	---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: [Signature]  
OUR RESPONSIBILITY ENDS AT THE CURB  
White = IROQUOIS Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255132	SCALE 1	AUTOMANUAL W	DATE 06/06/2024	TIME 7:09 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 74,200	37.10 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 89.36	LOADS 4	HAUL
46,360	23.18 Ton	NET	TODATE 3,691.76	LOADS 165	ADD'L CHARGES
23.18		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>WHEN ALL RIGHTS ARE EXHAUSTED THE LIABILITY OF THE MANUFACTURER SHALL BE LIMITED TO THE EXTENT PERMITTED BY LAW AND SHALL NOT EXCEED THE AMOUNT PAID FOR THE PRODUCT.</small>
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255132		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255258	SCALE 1	AUTO/MANUAL W	DATE 06/06/2024	TIME 9:45 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 69,980	34.99 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 219.73	LOADS 10	HAUL
42,140	21.07 Ton	NET	TODATE 3,822.13	LOADS 171	ADD'L CHARGES
21.07		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>           A REFUSE CHARGE WILL BE APPLIED TO THE MONTHLY ALLOWABLE BY LAW IF ALL REAPPLIED TOTAL AMOUNTS OVER 20 DAYS PART USE.         </small>
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255258		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255365	SCALE 1	AUTO/MANUAL W	DATE 06/06/2024	TIME 12:02 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 70,260	35.13 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 328.27	LOADS 15	HAUL
42,420	21.21 Ton	NET	TODATE: 3,930.67	LOADS 176	ADD'L CHARGES
21.21		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					RESERVE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW WILL BE APPLIED TO ALL AMOUNTS OVER 30 DAYS PAST DUE
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255365		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255445	SCALE 1	AUTOMANUAL W	DATE 06/06/2024	TIME 2:06 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,460	35.73 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 394.72	LOADS 18	HAUL
43,620	21.81 Ton	NET	TODATE 3,997.12	LOADS 179	ADD'L CHARGES
21.81		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW					YOUR SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWANCE BY LAW WILL BE APPLIED TO ALL AMOUNTS OVER 90 DAYS PAST DUE
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (inhalation). May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).</b> <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255445		PICKUP	

ORIGINAL - CUSTOMER

**Iroquois Bar Corp.  
Dba Oneida Trucking**

155 Commerce Drive  
Lackawanna, New York 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 109,281 | Date: 6-7-24

Customer: S.T.C

Job: Waste chip treatment

Truck No. 31 Driver: Deonta

LOAD LOCATION <u>Waste</u>	Job Start <u>8:30</u>
DUMP LOCATION <u>Sturgeon Point WWP</u>	Job Finish <u>6:30 2:50</u>
MATERIAL <u>2" crusher</u>	Travel Time <u>1 HR</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>9.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50255519	20.91	7:55 - 8:10	6:30 - 7:07
2	50255628	22.99	10:05 - 10:18	9:00 - 9:15
3	50255742	23.41	12:18 - 12:26	11:18 - 11:30
4	50255830	22.13	2:35 - 2:50	1:17 - 1:30
5			---	---
6			---	---
7	<u>Waste</u>	<u>89.44T</u>	---	---
8			---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255519	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 7:04 am
SOLD TO: Iroquols Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquols Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 69,660	34.83 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 89.31	LOADS 4	HAUL
41,820	20.91 Ton	NET	TODATE 4,086.43	LOADS 183	ADD'L CHARGES
20.91		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/>
Truck Desc: - Iroquols Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255519		PICKUP	

ORIGINAL - CUSTOMER





# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255628	SCALE 1	AUTO/MANUAL W	DATE 05/07/2024	TIME 9:09 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 36705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,820	36.91 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 156.74	LOADS 7	HAUL
45,980	22.99 Ton	NET	TQDATE 4,153.86	LOADS 186	ADD'L CHARGES
22.99		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14487				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW					ADDITIONAL CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW/WEHLE APPLIED TO ALL AMOUNTS OVER 30 DAYS PAST DUE
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> < <a href="http://www.nesi.com">http://www.nesi.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255628		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255742	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 11:26 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 74,660	37.33 Ton	GROSS	ORDERED 500.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 268.57	LOADS 12	HAUL
46,820	23.41 Ton	NET	TODATE 4,265.69	LOADS 191	ADD'L CHARGES
23.41		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					IF A SERVICE CHARGE SHOULD EXCEED THE BUDGET ALLOWANCE, YOU WILL BE RESPONSIBLE FOR ALL AMOUNTS OVER THE BUDGET.
<b>X</b>					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255742		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255830	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 1:25 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 35705MG	AXLES 0	TRUCK BIB031	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,100	36.05 Ton	GROSS	ORDERED 800.00	MATERIAL	
27,840	13.92 Ton	TARE	TODAY 356.36	LOADS 16	HAUL
44,260	22.13 Ton	NET	TODATE 4,353.48	LOADS 195	ADD'L CHARGES
22.13		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW WILL BE APPLIED TO ALL ACCOUNTS OVER 30 DAYS PAST DUE.</small>
X					
Truck Desc: - Iroquois Bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255830		PICKUP	

ORIGINAL - CUSTOMER

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 104,877 | Date: 6/10/24

Customer: ~~XXXXXXXX~~ STC  
 Job: Waste Water Treatment Sturgeon Point  
 Truck No. 44 Driver Mike

LOAD LOCATION NESE Wehrle  
 DUMP LOCATION Waste Water Treatment Plant  
 MATERIAL 2" crusher  
 REMARKS \_\_\_\_\_

Job Start 715A  
 Job Finish 115P  
 Travel Time \_\_\_\_\_  
 Lunch  No Lunch  
 Total 7

LD #	TICKET #	WEIGHT	JOB		PLANT	
			IN - OUT	WAIT TIME	IN - OUT	
1	5922	21.04	715 - 735		829 - 836	
2	6007	21.38	930 - 947		1036 - 1041	
3	6079	21.05	1135 - 1149		1239 - 115	21
4			---		---	
5	Wehrle	103.417	---		---	
6			---		---	
7		1.35 WT	---		---	
8			---		---	
9			---		---	
10			---		---	
11			---		---	
12			---		---	
13			---		---	
14			---		---	
15			---		---	

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255922	SCALE 1	AUTO/MANUAL W	DATE 06/10/2024	TIME 7:27 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BJB044	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,500	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 67,740	33.87 Ton	GROSS	ORDERED 500.00	MATERIAL	
25,660	12.83 Ton	TARE	TODAY 41.61	LOADS 2	HAUL
42,080	21.04 Ton	NET.	TODATE 4,415.88	LOADS 198	ADD'L CHARGES
21.04		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: Iroquoisa bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products(inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255922		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50256007	SCALE 2	AUTOMANUAL W	DATE 06/10/2024	TIME 9:38 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB044	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,500	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 68,420	34.21 Ton	GROSS	ORDERED 500.00	MATERIAL	
25,660	12.83 Ton	TARE	TODAY 62.99	LOADS 3	HAUL
42,760	21.38 Ton	NET	TODATE 4,437.36	LOADS 199	ADD'L CHARGES
21.38		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: Iroquoise bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> < <a href="http://www.nesi.com">http://www.nesi.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50256007		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLA AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50256079	SCALE 1	AUTOMANUAL W	DATE 06/10/2024	TIME 11:44 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB044	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,500	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 67,760	33.88 Ton	GROSS	ORDERED 500.00	MATERIAL	
25,660	12.83 Ton	TARE	TODAY 103.27	LOADS 5	HAUL
42,100	21.05 Ton	NET	TODATE 4,477.64	LOADS 201	ADD'L CHARGES
21.05		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: Iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50256079		PICKUP	

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 108,594 | Date: 6/14/24

Customer: SIC

Job: Sturgeon Pt

Truck No. 53 Driver Joe McEvoy

LOAD LOCATION	<u>Sturgeon Pt</u>	Job Start	<u>7:15</u>
DUMP LOCATION	<u>794 Braut Farmhouse</u>	Job Finish	<u>11:40</u>
MATERIAL	<u>Dirt</u>	Travel Time	<u>1:00</u>
REMARKS	<u>11:40 - Breakfast</u>	<input type="checkbox"/> Lunch	<input checked="" type="checkbox"/> No Lunch
		Total	<u>(5.5)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1			7:15 - 7:20	7:40 - 7:50
2			8:05 - 8:20	8:35 - 8:40
3			8:55 - 9:05	9:20 - 9:25
4			9:40 - 9:50	10:05 - 10:10
5			10:25 - 10:35	10:50 - 10:55
6			11:15 - 11:25	11:40 -
7			---	---
8			---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: \_\_\_\_\_

**OUR RESPONSIBILITY ENDS AT THE CURB**  
 White = IROQUOIS • Yellow = JOB



**Iroquois Bar Corp.  
Dba Oneida Trucking**

155 Commerce Drive  
Lackawanna, New York 14218  
Phone: (716) 270-0433  
Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS - TRUCKING - CONSTRUCTION SERVICES

1/2 Mileage Finish: 295204  
Start: 294915

No. 105,759 | Date: 6-6-24

Customer: S.T.C.  
Job: Sturgeon Point wastewater  
Truck No. 30 Driver Lawrence mangus

LOAD LOCATION <u>NESL</u>	Job Start <u>6:30 AM</u>
DUMP LOCATION <u>Sturgeon Point</u>	Job Finish <u>2:15 pm</u>
MATERIAL <u>2" crusher</u>	Travel Time <u>1 HR</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(8.75)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT	
			IN - OUT		IN - OUT	
1	50255133	21.52 <sup>a</sup>	813	830	630	715
2	50255250	23.38	1037	1050	920	945
3	50255354	21.58 <sup>5</sup>	1265	215	1140	1155
4			-	-	-	-
5			-	-	-	-
6	Wenrle	60.48 T	-	-	-	-
7		12 WT	-	-	-	-
8			-	-	-	-
9			-	-	-	-
10			-	-	-	-
11			-	-	-	-
12			-	-	-	-
13			-	-	-	-
14			-	-	-	-
15			-	-	-	-

Customer Signature: \_\_\_\_\_

**OUR RESPONSIBILITY ENDS AT THE CURB**  
White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255133	SCALE 2	AUTO/MANUAL W	DATE 06/06/2024	TIME 7:09 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB030	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,000		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 71,500	35.75 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,460	14.23 Ton	TARE	TODAY 110.88	LOADS 5	HAUL
43,040	21.52 Ton	NET	TODATE 3,713.28	LOADS 166	ADD'L CHARGES
21.52		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/>
Truck Desc: Iroquois					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</p>					
Plant #: 54230100		Ticket #: 50255133		PICKUP	

ORIGINAL - CUSTOMER



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd

Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255250	SCALE 2	AUTOMANUAL W	DATE 06/06/2024	TIME 9:39 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB030	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,000		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 75,220	37.61 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,460	14.23 Ton	TARE	TODAY 198.66	LOADS 9	HAUL
46,760	23.38 Ton	NET	TODATE 3,801.06	LOADS 170	ADD'L CHARGES
23.38		Ton	ACCUMULATED CASH SALE		TAX
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>A REFUSE QUANTITY NOT TO EXCEED THE MAXIMUM ALLOWABLE TONNAGE WILL BE APPLIED TO ALL LOADS OVER 90 DAYS PAST DUE.</small>
X					
Truck Desc: Iroquois					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255250		PICKUP	

ORIGINAL - CUSTOMER




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255354	SCALE 1	AUTOMANUAL W	DATE 06/06/2024	TIME 11:49 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB030	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,000		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 71,620	35.81 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,460	14.23 Ton	TARE	TODAY 285.02	LOADS 13	HAUL
43,160	21.58 Ton	NET	TODATE 3,887.42	LOADS 174	ADD'L CHARGES
21.58		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					A SERVICE CHARGE TO REPAIR THE MASHIN APPLICABLE BY LAW WILL BE ADDED TO ALL ACCOUNTS OVERS AND DEFUL
X					
Truck Desc: Iroquois					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255354		PICKUP	

ORIGINAL - CUSTOMER

...s Bar Corp.  
**Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
MATERIALS - TRUCKING - CONSTRUCTION SERVICES

212 295204  
 Mileage Finish: 295204  
 Start: 294915

No. 105,760 | Date: 6-6-24

Customer: S. J. L.  
 Job: sturgeon Point waste water  
 Truck No. 30 Driver Lawrence mangus

LOAD LOCATION	<u>Nes L</u>	Job Start	<u>2:15pm</u>
DUMP LOCATION	<u>sturgeon Point</u>	Job Finish	<u>3:00pm</u>
MATERIAL	<u>crush "Zinch</u>	Travel Time	<u>1 HR</u>
REMARKS		<input type="checkbox"/> Lunch	<input checked="" type="checkbox"/> No Lunch
		Total	

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	<u>50255436</u>	<u>22.10</u>	<u>256-300</u>	<u>2:15-2:20</u>
2			-	-
3			-	-
4			-	-
5			-	-
6			-	-
7			-	-
8			-	-
9			-	-
10			-	-
11			-	-
12			-	-
13			-	-
14			-	-
15			-	-

*Signed out*  
*2:15pm - called*  
*George for one*  
*more load*

Customer Signature: [Signature]  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255436	SCALE 2	AUTO/MANUAL W	DATE 06/06/2024	TIME 1:53 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB030	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 78,000	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,560	36.33 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,460	14.23 Ton	TARE	TODAY 372.91	LOADS 17	HAUL
44,200	22.10 Ton	NET	TODATE 3,975.31	LOADS 178	ADD'L CHARGES
22.10		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X					
Truck Desc: Iroquois					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255436		PICKUP	

ORIGINAL - CUSTOMER

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 100,847 | Date: 6/3/21

Customer: STC  
 Job: Sturgeon Point Water Treatment Plant  
 Truck No. 58 Driver Marcus

LOAD LOCATION <u>SPWTP</u>	Job Start <u>1130</u>
DUMP LOCATION <u>K100 Pontiac</u>	Job Finish <u>320</u>
MATERIAL <u>gr</u>	Travel Time _____
REMARKS _____	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>4.75</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1			1130-1140	1150-1205
2			1220-1225	1250-1255
3			110-120	135-140
4			1150-1200	215-220
5			250-300	315-320
6			—	—
7			—	—
8			—	—
9			—	—
10			—	—
11			—	—
12			—	—
13			—	—
14			—	—
15			—	—

Customer Signature: Don STC  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0439  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

No. 103,133 | Date: 6/10/24 Gallons: \_\_\_\_\_

Customer: STC

Job: Waste Water Surgeon Pt

Truck No. 11 Driver Mike Gallagher

LOAD LOCATION <u>Wehrle</u>	Job Start <u>630 AM</u>
DUMP LOCATION <u>Surgeon Pt</u>	Job Finish <u>245</u>
MATERIAL <u>2"</u>	Travel Time <u>1 hr</u>
REMARKS <u>Tonnage</u>	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>9.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50255118	21.31	750-800	630-700
2	50255257	21.46	1010-1045	555-925
3	50255348	22.15	1230-1240	1130-1145
4	50255426	22.54	230-245	130-140
5			---	---
6	Wehrle	87.46T	---	---
7		133 WT	---	---
8			---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB





# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 10D0393244	TICKET NUMBER 50255118	SCALE 2	AUTO/MANUAL W	DATE 06/06/2024	TIME 6:54 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 53546JW	AXLES 3	TRUCK BIB011	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US-WEIGHT 71,300	35.65 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,660	14.34 Ton	TARE	TODAY 66.18	LOADS 3	HAUL
42,620	21.31 Ton	NET	TODATE 3,666.58	LOADS 164	ADD'L CHARGES
21.31		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>A SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE TARIFF WILL BE APPLIED TO ALL ACCOUNTS OVER 90 DAYS PAST DUE.</small>
X					
Truck Desc: Iroquois bar					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.</p>					
Plant #: 54230100	Ticket #: 50255118	PICKUP			

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000383244	TICKET NUMBER 50255234	SCALE 1	AUTO/MANUAL W	DATE 06/06/2024	TIME 9:20 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 53546JW	AXLES 3	TRUCK BIB011	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,600	35.80 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,680	14.34 Ton	TARE	TODAY 155.11	LOADS 7	HAUL
42,920	21.46 Ton	NET	TODATE 3,757.51	LOADS 168	ADD'L CHARGES
21.46		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION. YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/> <small>IF SERVICE CHARGE NOT TO EXCEED \$100 PER HOUR ALLOWED PER HOUR WORK IS APPLIED TO ALL ACCOUNTS ON FILE. DATED 06/01/11</small>
X Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> if exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product to determine the appropriate ventilation or respiratory protection necessary to safeguard your health.</b> The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255234		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255348	SCALE 1	AUTO/MANUAL W	DATE 06/06/2024	TIME 11:42 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14216-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 53546JW	AXLES 3	TRUCK BIB011	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,980	36.49 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,680	14.34 Ton	TARE	TODAY 283.44	LOADS 12	HAUL
44,300	22.15 Ton	NET	TODATE 3,865.84	LOADS 173	ADD'L CHARGES
22.15		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>PLEASE REFER TO THE NESESL WEBSITE FOR THE LATEST VERSION OF THE TERMS &amp; CONDITIONS WHICH WILL BE APPLIED TO ALL ORDERS OVER 30 DAYS PART-DUE.</small>
X					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100 Ticket #: 50255348 PICKUP					

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255426	SCALE 2	AUTO/MANUAL W	DATE 05/06/2024	TIME 1:37 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 53546JW	AXLES 3	TRUCK BIB011	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,760	36.88 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,680	14.34 Ton	TARE	TODAY 350.81	LOADS 16	HAUL
45,080	22.54 Ton	NET	TODATE 3,953.21	LOADS 177	ADD'L CHARGES
22.54		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/>
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255426		PICKUP	

HAULER

Void - Customer Do Not Accept

**iroquois Bar Corp.**  
**Dbà Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

No. 103,134 | Date: 6/7/24 Gallons: \_\_\_\_\_

Customer: STC  
 Job: Sturgeon Pt  
 Truck No. 53 Driver Mike Gagliardi

LOAD LOCATION <u>Wehrle</u>	Job Start <u>7:50 AM</u>
DUMP LOCATION <u>Sturgeon Pt</u>	Job Finish <u>3:00 PM</u>
MATERIAL <u>2"</u>	Travel Time <u>1 hr</u>
REMARKS <u>Tonnage</u>	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>8.25</u>

LD #	TICKET #	WEIGHT	JOB		PLANT	
			IN - OUT	WARR-TIME	IN - OUT	
1	50255563	22.07	850	900	750	905
2	50255665	22.28	1045	1055	950	1000
3	50255756	22.04	1240	1250	1140	1150
4	50255856	20.85	5240	300	135	145
5			—		—	
6			—		—	
7	<u>Wehrle</u>	<u>87.28T</u>	—		—	
8			—		—	
9		<u>1.08 WT</u>	—		—	
10			—		—	
11			—		—	
12			—		—	
13			—		—	
14			—		—	
15			—		—	

Customer Signature: Don STC

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255563	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 7:59 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280431	PRODUCT DESCRIPTION STONE, NY #1				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB053	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,800	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,680	36.34 Ton	GROSS	ORDERED 0.00	MATERIAL	
28,540	14.27 Ton	TARE	TODAY 22.07	LOADS 1	HAUL
44,140	22.07 Ton	NET	TODATE 327.87	LOADS 15	ADD'L CHARGES
22.07		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD ➤
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESSLER TERMS & CONDITIONS REFERENCED BELOW					IF THERE IS A CHANGE IN THE WEIGHT OF THE MATERIAL ALL CHARGES WILL BE ADJUSTED TO ALL NUMBERS OVER 30 DAYS PAST DUE
X					
Truck Desc: iroquois bar					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255563		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 100093244	TICKET NUMBER 50255668	SCALE 2	AUTO/MANUAL W	DATE 06/07/2024	TIME 9:57 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280431	PRODUCT DESCRIPTION STONE, NY #1				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB053	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,800	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,100	38.55 Ton	GROSS	ORDERED 0.00	MATERIAL	
28,540	14.27 Ton	TARE	TODAY 44.35	LOADS 2	HAUL
44,560	22.28 Ton	NET	TODATE 350.15	LOADS 16	ADD'L CHARGES
22.28		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED 10% MODEL IN ALLOWANCE OF LAW WILL BE APPLIED TO ALL RESIDENTS WITHIN 30 DAYS OF DELIVERY</small>
X					
Truck Desc: iroquois bar					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation). May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation).</b> <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100      Ticket #: 50255668      PICKUP					

HAULER

Void - Customer Do Not Accept




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd

Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255756	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 11:45 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280431	PRODUCT DESCRIPTION STONE, NY #1				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB053	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,800	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,620	36.31 Ton	GROSS	ORDERED 0.00	MATERIAL	
26,540	14.27 Ton	TARE	TODAY 66.39	LOADS 3	HAUL
44,080	22.04 Ton	NET	TODATE 372.19	LOADS 17	ADD'L CHARGES
22.04		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD ➔
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE TO BE APPLIED SHALL APPLY TO THIS DATE PARTIAL
<b>X</b>					
Truck Desc: iroquois bar					
 <p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> or by calling (814) 766-2211.</p>					
Plant #: 54230100	Ticket #: 50255756	PICKUP			

HAULER

Void - Customer Do Not Accept





**New Enterprise Stone & Lime Co., Inc.**

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255836	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 1:40 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO.	AXLES 0	TRUCK BIB053	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 77,800	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 70,320	35.16 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,540	14.27 Ton	TARE	TODAY 377.25	LOADS 17	HAUL
41,780	20.89 Ton	NET	TODATE 4,374.37	LOADS 196	ADD'L CHARGES
20.89		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM SERVICE CHARGE PER HOUR SHALL BE PAID TO ALL PARTICIPATING PARTIES.</small>
X					
Truck Desc: iroquois bar					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products(Inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and International regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a>. <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.</p>					
Plant #: 54230100	Ticket #: 50255836	PICKUP			

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_  
 Gallons: \_\_\_\_\_

No. 101,977 | Date: 10-4-2024

Customer: S.T.C.  
 Job: Sturgeon Point W.W. Plant  
 Truck No. 050 Driver Paul Gaphart

LOAD LOCATION Sturgeon W.W. Plant Job Start 7:15  
 DUMP LOCATION 794 Brantfarcham Rd Job Finish 3:25  
 MATERIAL Spd's Travel Time 1 Hr  
 Lunch  No Lunch  
 REMARKS Total (9)

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	<del>111</del>	Lo's	7:15 - 7:25	7:41 - 7:44
2	<del>111</del>	Spd's	7:59 - 8:09	8:25 - 8:28
3	1		8:42 - 8:53	9:09 - 9:12
4			9:28 - 9:36	9:53 - 9:56
5			10:11 - 10:23	10:38 - 10:41
6			10:57 - 11:06	11:21 - 11:25
7			11:40 - 11:51	12:07 - 12:11
8			12:25 - 12:36	12:50 - 12:57
9			1:11 - 1:23	1:38 - 1:42
10			1:57 - 2:07	2:23 - 2:27
11			2:38 - 2:48	3:10 - 3:15
12			-	-
13			-	-
14			-	-
15			-	-

Customer Signature: [Signature]  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**IROQUOIS Bar Corp.**  
**DbA Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING CONSTRUCTION SERVICES

Mileage Finish: 1/2  
 Start: \_\_\_\_\_

No. 101,306 | Date: 6-12-24

Customer: STC  
 Job: Surgear Point  
 Truck No. 14 Driver: Paul Yernye

LOAD LOCATION <u>Surgear Point</u>	Job Start <u>700</u>
DUMP LOCATION <u>On Site</u>	Job Finish <u>200</u>
MATERIAL <u>Dirt</u>	Travel Time <u>1hr</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>8</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	1 load	Dirt	710	—
2	2 load	}	—	—
3	3 load		—	—
4	4 load		—	—
5	5 load		—	—
6	6 load		—	—
7	7 load		—	—
8	8 load		—	—
9	9 load		—	—
10	10 load		—	—
11	11 load		—	—
12	12 load		—	—
13	13 load		—	—
14	14 load		—	—
15	15 load		—	—

Customer Signature: R. Enke

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = \_\_\_\_\_

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIAL TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: 212  
 Start: \_\_\_\_\_

No. 101,307 | Date: 6-12-79 Gallons: \_\_\_\_\_

Customer: STC 101306  
 Job: Sturgeon Point  
 Truck No. 19 Driver Paul Yernoye

LOAD LOCATION <u>Sturgeon Point</u>	Job Start <u>700</u>
DUMP LOCATION <u>on site</u>	Job Finish <u>300</u>
MATERIAL <u>Dirt</u>	Travel Time <u>1hr</u>
REMARKS _____	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total _____

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	16 load	Dirt	—	—
2	17 load	<del>1</del>	—	—
3	18 load	<del>1</del>	—	—
4	19 load		—	—
5	20 load		—	—
6	21 load		—	—
7	22 load		—	—
8	23 load		—	—
9			—	—
10			—	—
11			—	—
12			—	—
13			—	—
14			—	—
15			—	—

Customer Signature: \_\_\_\_\_

*Handwritten signature*

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**  
 155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_  
 Gallons: \_\_\_\_\_

No. 101,374 | Date: 6-4-24

Customer: STC  
 Job: \_\_\_\_\_  
 Truck No. 43 Driver Paul Yernye

LOAD LOCATION <u>Sturgeon Point</u>	Job Start <u>115</u>
DUMP LOCATION <u>794 Grant</u>	Job Finish <u>255</u>
MATERIAL <u>Dirt</u>	Travel Time <u>1hr</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>2.75</u>

LD #	TICKET #	WEIGHT	JOB		WAIT-TIME		PLANT	
			IN	OUT	IN	OUT	IN	OUT
1	1load	Dirt	115	130	150	200		
2	2load	Dirt	215	230	245	255		
3								
4								
5								
6								
7								
8								
9								
10								
11								
12								
13								
14								
15								

Customer Signature: \_\_\_\_\_  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 101,375 | Date: 6-5-24

Customer: SIC  
 Job: 24789  
 Truck No. 14 Driver: Paul Yernye

LOAD LOCATION <u>Sturgeon Point</u>	Job Start <u>600</u>
DUMP LOCATION <u>794 Brant</u>	Job Finish <u>830</u>
MATERIAL <u>Dirt</u>	Travel Time <u>1hr</u>
REMARKS <u>1/4 CRUSHED #2</u>	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>10.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	1 Load	Dirt	600 - 625	640 - 650
2	2 Load		705 - 715	730 - 740
3	3 Load		755 - 805	820 - 825
4	4 Load	∨	840 - 855	910 - 915
5	50254860	21.78	1010 - 1025	1110 - 1120
6	50254947	22.05	1200 - 1215	105 - 115
7	50255053	22.81	210 - 225	315 - 320
8			-	-
9	Hourly:	1000-1010	4.25	-
10	Travel	15	-	-
11	Wenrye	Wenrye	-	-
12			-	-
13			-	-
14			-	-
15			-	-

Customer Signature: [Signature]  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50254860	SCALE 2	AUTO/MANUAL W	DATE 06/05/2024	TIME 10:18 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 78286KA	AXLES 3	TRUCK BIB014	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,720	36.36 Ton	GROSS	ORDERED 500.00	MATERIAL	
29,160	14.58 Ton	TARE	TODAY 21.78	LOADS 1	HAUL
43,560	21.78 Ton	NET	TODATE 3,557.54	LOADS 169	ADD'L CHARGES
21.78		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50254860		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50254947	SCALE 2	AUTOMANUAL W	DATE 06/05/2024	TIME 12:09 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 78286KA	AXLES 3	TRUCK BIB014	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,260	36.63 Ton	GROSS	ORDERED 500.00	MATERIAL	
29,160	14.58 Ton	TARE	TODAY 43.83	LOADS 2	HAUL
44,100	22.05 Ton	NET	TODATE 3,579.59	LOADS 160	ADD'L CHARGES
22.05		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICES ARE PROVIDED BY NESL, THE LIABILITY OF THE CUSTOMER SHALL BE LIMITED TO THE EXTENT OF THE SERVICES PROVIDED BY NESL.</small>
X					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.</p>					
Plant #: 54230100		Ticket #: 50254947		PICKUP	

HAULER

Void - Customer Do Not Accept





# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255053	SCALE 2	AUTO/MANUAL W	DATE 06/05/2024	TIME 2:19 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 78286KA	AXLES 3	TRUCK BIB014	CARRIER NAME Iroquois Bar Corp		CARRIER CODE 82496
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 74,780	37.39 Ton	GROSS	ORDERED 500.00	MATERIAL	
29,160	14.58 Ton	TARE	TODAY 66.64	LOADS 3	HAUL
45,620	22.81 Ton	NET	TODATE 3,602.40	LOADS 161	ADD'L CHARGES
22.81		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF A SERVICE CHARGE IS TO BE PAID THE MAXIMUM ALLOWABLE FEE WILL BE APPLIED TO ALL ACCOUNTS OVER \$5,000.00</small>
X					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> or by calling (814) 766-2211.</p>					
Plant #: 54230100		Ticket #: 50255053		PICKUP	

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 102,951 | Date: 6-06-24

Customer: STP

Job: Waste Water Treatment STURGEON POINT

Truck No. #16 Driver LARRY ROSINSKI

LOAD LOCATION <u>Wt Wehrle</u>	Job Start <u>6:30</u>
DUMP LOCATION <u>WASTE WATER TREATMENT PT - STURGEON PT</u>	Job Finish <u>12:53</u>
MATERIAL <u>2" CRUSHER</u>	Travel Time <u>1 HR.</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>7.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT	
			IN - OUT	IN - OUT	IN - OUT	IN - OUT
1	50255116	21.94	6:36	7:00	7:50	8:05
2	50255036	20.17	9:00	9:29	10:19	10:50
3	50255355	22.04	11:41	11:55	12:43	12:53
4						
5	Wehrle	64.15				
6		2 TWT				
7						
8						
9						
10						
11						
12						
13						
14						
15						

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO.  
1000393244

TICKET NUMBER  
50255116

SCALE  
2

AUTOMANUAL  
W

DATE  
06/06/2024

TIME  
6:53 am

**SOLD TO:**

Iroquois Bar Corp  
155 Commerce Dr  
Lackawanna, NY 14218-

CUSTOMER: 82496

PHONE:

PO #: 2023 Sturgeon Point Water Treatment

**SHIP TO:**

Sturgeon Point Water Treatment

QUOTE:

STATE NY

ZONE:

PRODUCT ID  
280300

PRODUCT DESCRIPTION  
STONE, 2" CRUSHER RUN

JOB NAME / LOCATION  
2023 Sturgeon Point Water Treatment

Item

JOB REQUIRED NUMBERS  
COUNTY: 2023 Sturgeon Point Water Treatment

TAG NO.  
28418MC

AXLES  
4

TRUCK  
BIB016

CARRIER NAME

CARRIER CODE

FREIGHT  
PICKUP

FREIGHT COLLECT  
0

ACCUMULATIVE  
QUANTITIES

PAYMENT METHOD  
CREDIT

US WEIGHT  
72,280

36.14 Ton

GROSS

ORDERED  
500.00

MATERIAL

28,400

14.20 Ton

TARE

TODAY  
44.87

LOADS  
2

HAUL

43,880

21.94 Ton

NET

TODATE  
3,647.27

LOADS  
163

ADD'L  
CHARGES

21.94

Ton

ACCUMULATED CASH SALE

TAX

WEIGHED BY

14497

TOTAL THIS  
LOAD



INSPECTOR'S SIGNATURE

JOB ARRIVAL TIME

JOB DEPARTURE TIME

RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW

X

IF SERVICE CHARGE IS NOT PAID BY THE END OF THE MONTH A SERVICE CHARGE WILL BE APPLIED TO ALL ACCOUNTS IN COMPLIANCE WITH NEEL TERMS & CONDITIONS

Truck Desc: IROQUIOS BAR DBA SENECA MTRL



**Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).** May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation).

**Prevention:** Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. **Response:** If exposed or concerned, get medical advice/attention. **Handling and Storage:** Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. **Disposal:** Dispose of contents/container in accordance with all local, regional, national and international regulations. **Read the Safety Data Sheet (SDS) before handling this product** to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at [www.nesl.com](http://www.nesl.com) <<http://www.nesl.com>> or by calling (814) 766-2211.

Plant #: 54230100

Ticket #: 50255116

PICKUP



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255236	SCALE 2	AUTO/MANUAL W	DATE 06/06/2024	TIME 9:22 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 68,740	34.37 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 175.28	LOADS 8	HAUL
40,340	20.17 Ton	NET	TODATE 3,777.68	LOADS 169	ADD'L CHARGES
20.17		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW					<input checked="" type="checkbox"/>
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product to determine the appropriate ventilation or respiratory protection necessary to safeguard your health.</b> The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesi.com">www.nesi.com</a> < <a href="http://www.nesi.com">http://www.nesi.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255236		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255355	SCALE 1	AUTO/MANUAL W	DATE 06/06/2024	TIME 11:50 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 290300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 72,480	36.24 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 307.06	LOADS 14	HAUL
44,080	22.04 Ton	NET	TODATE 3,909.46	LOADS 175	ADD'L CHARGES
22.04		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>A FEE OF CHARGE NOT TO EXCEED THE AMOUNT ALLOWABLE BY LAW WILL BE APPLIED TO ALL ACCOUNTS OVER 30 DAYS PAST DUE.</small>
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255355		PICKUP	

HAULER

Void - Customer Do Not Accept

**IROQUOIS Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS - TRUCKING - CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 102,953 | Date: 6-07-2024

Customer: STC  
 Job: Waste Water Treatment Sturgeon Point  
 Truck No. #16 Driver LARRY ROSINSKI

LOAD LOCATION <u>NEEL Wehrle</u>	Job Start <u>6:30</u>
DUMP LOCATION <u>WASTE WATER TREATMENT PLOT AT STURGEON POINT</u>	Job Finish <u>2:15</u>
MATERIAL <u>2" CRUSHER</u>	Travel Time <u>1 HR</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(8.75)</u>

LD #	TICKET #	WEIGHT	JOB		WAIT-TIME		PLANT	
			IN	OUT	IN	OUT	IN	OUT
1	50255512	21.50	6:30	7:03	7:44	8:00		
2	50255619	22.38	8:50	9:01	9:55	10:04		
3	5025572	21.47	10:51	11:08	12:02	12:12		
4	50255816	21.57	1:01	2:03	2:03	2:15		
5								
6								
7	Wenre	86.92 T						
8								
9								
10								
11								
12								
13								
14								
15								

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255512	SCALE 2	AUTO/MANUAL W	DATE 06/07/2024	TIME 6:59 am
SOLD TO: Iroquios Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,400	35.70 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 44.24	LOADS 2	HAUL
43,000	21.50 Ton	NET	TODATE 4,041.36	LOADS 181	ADD'L CHARGES
21.50		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100		Ticket #: 50255512		PICKUP	

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255619	SCALE 1	AUTOMANUAL W	DATE 06/07/2024	TIME 8:59 am
SOLD TO: Iroquios Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,160	36.58 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 133.75	LOADS 6	HAUL
44,760	22.38 Ton	NET	TODATE 4,130.87	LOADS 185	ADD'L CHARGES
22.38		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					<small>IF SERVICE CHARGE NOT TO EXCEED THE MAXIMUM ALLOWABLE BY LAW WILL BE APPLIED TO ALL UNPAID OVERDUE DAYS PART OF THE SERVICE FEE WILL BE APPLIED TO THE BALANCE</small>
X					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> . <a href="http://www.nesl.com">http://www.nesl.com</a> or by calling (814) 766-2211.					
Plant #: 54230100 REPRINT		Ticket #: 50255619		PICKUP	

HAULER

Void - Customer Do Not Accept






# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
 Buffalo, New York 14227  
 Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255721	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 11:02 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-				CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment	
SHIP TO: Sturgeon Point Water Treatment				QUOTE: STATE NY ZONE:	
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment					Item
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,340	35.67 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 221.43	LOADS 10	HAUL
42,940	21.47 Ton	NET	TODATE 4,218.65	LOADS 189	ADD'L CHARGES
21.47		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497					TOTAL THIS LOAD ➔
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW <b>X</b>					<small>*A SERVICE CHARGE NOTE TO EXCEED THE MINIMUM ALLOWED BY LOCAL TARIFFS APPLIES TO ALL AMOUNTS OVER 90 DAYS PAST DUE.</small>
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
 <p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</p>					
Plant #: 54230100	Ticket #: 50255721	PICKUP			

HAULER

Void - Customer Do Not Accept



# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLE AGGREGATES (716) 826-7310

ORDER NO. 1000393244	TICKET NUMBER 50255816	SCALE 1	AUTO/MANUAL W	DATE 06/07/2024	TIME 1:08 pm
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Treatment		
SHIP TO: Sturgeon Point Water Treatment			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Treatment				Item	
JOB REQUIRED NUMBERS COUNTY: 2023 Sturgeon Point Water Treatment					
TAG NO. 28418MC	AXLES 4	TRUCK BIB016	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 0	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 71,540	35.77 Ton	GROSS	ORDERED 500.00	MATERIAL	
28,400	14.20 Ton	TARE	TODAY 312.24	LOADS 14	HAUL
43,140	21.57 Ton	NET	TODATE 4,309.36	LOADS 183	ADD'L CHARGES
21.57		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME		JOB DEPARTURE TIME
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NEEL TERMS & CONDITIONS REFERENCED BELOW					<small>A SERVICE CHARGE WILL BE ADDED TO THE MAXIMUM ALLOWABLE BY CARRIER TO BE PAID ALL MONTHS OVER 30 DAYS LATE DATE</small>
<b>X</b>					
Truck Desc: IROQUIOS BAR DBA SENECA MTRL					
<b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (inhalation). May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (inhalation). Prevention: Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. Response: If exposed or concerned, get medical advice/attention. Handling and Storage: Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. Disposal: Dispose of contents/container in accordance with all local, regional, national and international regulations. Read the Safety Data Sheet (SDS) before handling this product to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</b>					
Plant #: 54230100		Ticket #: 50255816		PICKUP	

HAULER

Void - Customer Do Not Accept

**Iroquois Bar Corp.**  
**DbA Oneida Trucking**



155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313

**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: 1/2  
 Start: \_\_\_\_\_

Gallons: \_\_\_\_\_  
 No. 102,959 | Date: 6-12-2024

Customer: STC  
 Job: WASTE WATER TREATMENT STURGEON POINT  
 Truck No. #16 Driver LARRY ROSINSKI

LOAD LOCATION <u>STURGEON POINT</u>	Job Start <u>7:00</u>
DUMP LOCATION <u>Inhouse</u>	Job Finish <u>2:05</u>
MATERIAL <u>DIRT</u>	Travel Time <u>1 HR</u>
REMARKS <u>Pg #1</u>	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>(8)</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	LOAD-1	LD DIRT	7:00	---
2	LOAD-2	LD	---	---
3	LOAD-3	LD	---	---
4	LOAD-4	LD	---	---
5	LOAD-5	LD	---	---
6	LOAD-6		---	---
7	LOAD-7		---	---
8	LOAD-8		---	---
9	LOAD-9		---	---
10	LOAD-10		---	---
11	LOAD-11		---	---
12	LOAD-12		---	---
13	LD-13		---	---
14	LD-14		---	---
15	LD-15		---	---

Customer Signature: \_\_\_\_\_

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**

MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: 2/2

Start: \_\_\_\_\_

Gallons: \_\_\_\_\_

No. 102,960 | Date: 6-12-2004

Customer: STC 102950

Job: Waste Water Treatment Sturgeon Point

Truck No. 46 Driver LARRY ROSINSKY

LOAD LOCATION <u>Sturgeon Point</u>	Job Start <u>7:00</u>
DUMP LOCATION <u>In house</u>	Job Finish <u>2:05</u>
MATERIAL <u>DIRT</u>	Travel Time _____
REMARKS <u>Pg #2</u>	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total _____

LD #	TICKET #	WEIGHT	JOB WAIT-TIME		PLANT
			IN - OUT	IN - OUT	
1	LD #16	DIRT	—	—	—
2	LD #17		—	—	—
3	LD #18		—	—	—
4	LD #19		—	—	—
5	LD #20		—	—	—
6	LD #21		—	—	—
7	LD 22		—	—	—
8	LD 23		—	—	—
9	LD 24		—	—	—
10				—	—
11			—	—	—
12			—	—	—
13			—	—	—
14			—	—	—
15			—	—	—

Customer Signature: R. Emke

OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB

**Iroquois Bar Corp.**  
**Db a Oneida Trucking**

155 Commerce Drive  
 Lackawanna, New York 14218  
 Phone: (716) 270-0433  
 Fax: (716) 824-5313



**IROQUOIS**  
 MATERIALS • TRUCKING • CONSTRUCTION SERVICES

Mileage Finish: \_\_\_\_\_  
 Start: \_\_\_\_\_  
 Gallons: \_\_\_\_\_

No. 100,647 | Date: 6/11/2024

Customer: S.T.C.  
 Job: Waste Water Treatment Sturgeon Point  
 Truck No. 040 Driver Tim

LOAD LOCATION <u>Waste - Sturgeon Point</u>	Job Start <u>6:30 AM</u>
DUMP LOCATION <u>Sturgeon Point</u>	Job Finish <u>10:45 AM</u>
MATERIAL <u>1"cr-2"cr - top soil</u>	Travel Time <u>1hr</u>
REMARKS	<input type="checkbox"/> Lunch <input checked="" type="checkbox"/> No Lunch
	Total <u>5.25</u>

LD #	TICKET #	WEIGHT	JOB WAIT-TIME PLANT	
			IN - OUT	IN - OUT
1	50256203	23.40	630 - 657	749 - 757
2	50256271	23.25	845 - 901	949 - 954
3	Topsoil moved on site	1Ld	954 - 1045	---
4			---	---
5	Waste hourly	41.65T	---	---
6		954 - 1045	---	---
7			---	---
8			---	---
9			---	---
10			---	---
11			---	---
12			---	---
13			---	---
14			---	---
15			---	---

Customer Signature: \_\_\_\_\_  
 OUR RESPONSIBILITY ENDS AT THE CURB  
 White = IROQUOIS • Yellow = JOB




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd  
Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRLÉ AGGREGATES (716) 826-7310

ORDER NO. 1000380865	TICKET NUMBER 50256203	SCALE 1	AUTO/MANUAL W	DATE 06/11/2024	TIME 6:59 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Tank Replacement etc.		
SHIP TO: Sturgeon Point Water Tank Replacement			QUOTE: STATE NY ZONE:		
PRODUCT ID 280284	PRODUCT DESCRIPTION STONE, 1" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Tank Replacement					Item
JOB REQUIRED NUMBERS COUNTY: ERIE 2023 Sturgeon Point Water Tank Replacement					
TAG NO.	AXLES 0	TRUCK BIB040	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 76,000		ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT
US WEIGHT 74,140	37.07 Ton	GROSS	ORDERED 0.00		MATERIAL
27,340	13.67 Ton	TARE	TODAY: 66.30	LOADS 3	HAUL
46,800	23.40 Ton	NET	TODATE 66.30	LOADS 3	ADD'L CHARGES
23.40		Ton	ACCUMULATED CASH SALE		TAX
WEIGHED BY 14497					TOTAL THIS LOAD ➤
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION. YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X <i>Tom</i>					
Truck Desc: Iroquois bar					
 <b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation). <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> < <a href="http://www.nesl.com">http://www.nesl.com</a> > or by calling (814) 766-2211.					
Plant #: 54230100	Ticket #: 50256203	PICKUP			

ORIGINAL - CUSTOMER




# New Enterprise Stone & Lime Co., Inc.

500 Como Park Blvd

Buffalo, New York 14227

Phone: (716) 826-7310 Fax: (716) 826-1342

PLANT INFORMATION - 54230100 - WEHRL AGGREGATES (716) 826-7310

ORDER NO. 1000380866	TICKET NUMBER 50256271	SCALE 2	AUTO/MANUAL W	DATE 06/11/2024	TIME 8:58 am
SOLD TO: Iroquois Bar Corp 155 Commerce Dr Lackawanna, NY 14218-			CUSTOMER: 82496 PHONE: PO #: 2023 Sturgeon Point Water Tank Replacement		
SHIP TO: Sturgeon Point Water Tank Replacement			QUOTE: STATE NY ZONE:		
PRODUCT ID 280300	PRODUCT DESCRIPTION STONE, 2" CRUSHER RUN				
JOB NAME / LOCATION 2023 Sturgeon Point Water Tank Replacement				Item	
JOB REQUIRED NUMBERS COUNTY: ERIE 2023 Sturgeon Point Water Tank Replacement					
TAG NO.	AXLES 0	TRUCK BIB040	CARRIER NAME		CARRIER CODE
FREIGHT PICKUP	FREIGHT COLLECT 76,000	ACCUMULATIVE QUANTITIES		PAYMENT METHOD CREDIT	
US WEIGHT 73,820	36.91 Ton	GROSS	ORDERED 0.00	MATERIAL	
27,320	13.66 Ton	TARE	TODAY 45.09	LOADS 2	HAUL
46,500	23.25 Ton	NET	TODATE 472.74	LOADS 21	ADD'L CHARGES
23.25		Ton	ACCUMULATED CASH SALE	TAX	
WEIGHED BY 14497				TOTAL THIS LOAD	
INSPECTOR'S SIGNATURE			JOB ARRIVAL TIME	JOB DEPARTURE TIME	
RECEIVED ABOVE MATERIAL IN GOOD CONDITION YOUR SIGNATURE OR ACTUAL RECEIPT/DELIVERY ACKNOWLEDGES ACCEPTANCE OF THE NESL TERMS & CONDITIONS REFERENCED BELOW					
X <i>T. Lee</i>					
Truck Desc: iroquois bar					
 <p><b>Crushed Stone, Pulverized Limestone, or Sand and Gravel DANGER - May Cause Cancer (Inhalation).</b> May cause damage to organs (lungs, respiratory system) through prolonged or repeated overexposure to dust from these products (Inhalation).  <b>Prevention:</b> Obtain special instructions before use. Do not handle until all safety precautions have been read and understood. Use personal protective equipment as required. Wear protective gloves, protective clothing, and eye protection. Wash hands thoroughly after handling. Do not eat, drink or smoke when using this product. <b>Response:</b> If exposed or concerned, get medical advice/attention. <b>Handling and Storage:</b> Follow personal protection and control measures set forth in the product SDS. Avoid dust formation and breathing dust. <b>Disposal:</b> Dispose of contents/container in accordance with all local, regional, national and international regulations. <b>Read the Safety Data Sheet (SDS) before handling this product</b> to determine the appropriate ventilation or respiratory protection necessary to safeguard your health. The risk of silicosis or lung cancer depends upon the duration and levels of silica exposure in the workplace. Safety Data Sheets are available at <a href="http://www.nesl.com">www.nesl.com</a> &lt;<a href="http://www.nesl.com">http://www.nesl.com</a>&gt; or by calling (814) 766-2211.</p>					
Plant #: 54230100		Ticket #: 50256271		PICKUP	

ORIGINAL - CUSTOMER

July 29, 2024

Arcadis of New York, Inc.  
50 Fountain Plaza, Suite 360  
Buffalo, New York 14202

Attn: Justin W. Francis

Subject: **Sturgeon Point Water Treatment Plant Washwater Tank Replacement**  
**Contract MP-088, ECWA Project 202100111**  
**Subgrade Preparation Report**  
**GGEA 21-1250 C**

Dear Mr. Francis:

Glynn Group Engineering & Architecture, PLLC (GGEA) has prepared this report to summarize subgrade preparation and Select Structural Fill placement for the washwater tank replacement project at the Sturgeon Point Water Treatment Plant in the Town of Evans, New York. A geotechnical report was issued for the project by GGEA on May 20, 2022, which identified approximately 6.0 feet of fill at the proposed tank location and recommended overexcavation to competent native soil and replacement with a minimum of 4.0 feet of Select Structural Fill (run of crusher stone) to achieve the required allowable bearing capacity of 6500 psf.

At the request of Arcadis, GGEA performed a site visit on May 30, 2024 to examine subgrade conditions at the established overexcavation depth, which were found to be of poor structural quality. GGEA recommended additional overexcavation of approximately 10 inches to engage stiff, undisturbed, native lean clay (CL) of good structural quality. This soil correlates to the N > 12 soil identified on the enclosed soil boring logs B-5 and B-6 below a depth of 6.0 feet. The site contractor (STC Construction) was instructed to advanced the excavation into this stiff lean clay (CL) soil throughout the entirety of the foundation excavation in accordance with the enclosed Field Observation Report (FOR) 24-01.

Select Structural was installed over the subgrade in lifts and compacted to 95 % modified proctor (ASTM D1557) in accordance with the recommendations of the geotechnical report. In place density testing was provided by Encorus Group as identified on the enclosed inspection reports. All recorded test results were found to be in excess of 95 % modified proctor with the exception of tests 1, 2 and 3 on June 5, 2024, for which the stone was recompacted and retested the following day with passing results.


Based on the recommendations provided by GGEA on May 30, 2024 and the in place density test reports provided by Encorus Group, it is GGEA's opinion subgrade preparation was performed in accordance with the provisions of the geotechnical report to achieve a net allowable bearing capacity of 6500 psf.

Sincerely,



G. Edward Lover, P.G.  
Manager of Geotechnical Services  
/gel

encl. Soil Boring Logs B-5 and B-5, GGEA FOR 24-01, Encorus Inspection Reports (6)

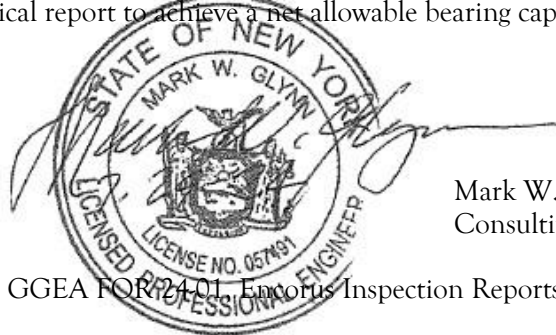

Mark W. Glynn, P.E.  
Consulting Engineer, Principal



Hole Number: SB-5






DATE: 1/19/2022

ELEVATION: \_\_\_\_\_

PROJECT: ECWA Sturgeon Point Washwater Tank Project

PREPARED FOR: Arcadis U.S., Inc.

BORING LOCATION: ECWA Sturgeon Point, Derby New York

SN	0/6	6/12	12/18	18/24	N	LITH	DESCRIPTION AND CLASSIFICATION	REC	COMMENTS
1	6						Topsoil 5" <span style="float:right">0.40</span>	1.0	
		6			18		Moist, gray (SANDY-SILT) with some fine to coarse size sand comprised of angular shale particles, trace clay, fill	1.0	
			12						
2	9			22					
		13							
			11		24			0.6	
3	7				15		Moist, faintly mottled, gray and brown (CLAYEY-SILT) with little clay, trace fine size sand, stiff, blocky soil structure, contains fine roots	1.3	
		8							
			7						
4	3				12			1.5	
		4			16				
			8						
				11					
5	4				12		Moist, dark gray (SILTY-SAND) with fine size sand, some silt, occasional coarse size sand particle, compact	1.4	No free standing water observed at boring completion.
		7							
			9						
				11					
					16				
6	3				13				
		6							
			7						
				7					
7	50/2"							0.0	No recovery








PROJECT NO.: 21-1050C    REPORT NO.: 24-01    DATE: 05.30.24    PAGE: 1 OF 2  
 PROJECT: Standpipe Concrete Washwater Tanks    DAY: Thursday  
 SUBJECT: Foundation Bearing Verification    PROJECT TIME: 8:45 am – 12:45 pm  
 CLIENT: Arcadis of New York, Inc.    SITE TIME: 9:45 am – 10:30 am  
 WEATHER: Sun, 55° F    PHOTOS: YES    X    NO


- STC Construction advanced a portion of the foundation excavation for Tank Location #3 to a depth 4.0 feet below the proposed foundation bearing elevation. Per the geotechnical report issued by GGEA on May 20, 2022, undisturbed native soil at Tank Location #3 will provide for a net allowable bearing capacity of 3,000 psf and a net allowable bearing capacity of 6,500 psf (as required by tank manufacturer) can be achieved with 4.0 feet of overexcavation and replacement with Select Structural Fill.
- The soil exposed at the 4.0 foot overexcavation depth was found to be composed of a mixture of stiff lean clay (CL), presumably native, and loose silty clayey sand (SC-SM) fill. The SC-SM fill material is of poor structural quality and should be removed beneath the proposed tank.
- STC advanced the excavation an additional +/- 10 inches to fully engage the stiff CL soil material. This additional excavation should be performed throughout the entirety of the tank footprint plus the prescribed horizontal distance beyond the edge of footing per the geotechnical report. The exposed stiff CL soil will provide for a net allowable bearing capacity of 3,000 psf. The required net allowable bearing capacity of 6,500 psf will be achieved once > 4.0 feet of Select Structural Fill is installed in lifts and compacted to 95% modified proctor density.
- Groundwater control should be provided as necessary to maintain a dry working environment. The CL soil will lose bearing strength if saturated.

PERSONNEL ON SITE / CONTACTED:  
Justin Francis – Arcadis

  
 \_\_\_\_\_  
 G. Edward Lover, P.G.

DISTRIBUTION: \_\_\_\_\_



DAILY MANHOURS: 4.0  
  
 \_\_\_\_\_  
 Mark W. Glynn, P.E.



ENGINEERING & ARCHITECTURE, PLLC

Civil • Geotechnical  
Structural • Architecture  
**FIELD OBSERVATION REPORT**

PROJECT NO.: 21-1050C REPORT NO.: 24-01 DATE: 06.01.24 PAGE: 2 OF 2



Photo 1. Exposed competent stiff CL subgrade soil.

---

GLYNN GROUP ENGINEERING & ARCHITECTURE, PLLC

415 South Transit Street, Lockport, New York 14094

voice 716.625.6933 / fax 716.625.6983

[www.glynngroup.com](http://www.glynngroup.com)

### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP88 Project No.: 24358  
 Client: Arcadis Contractor: STC Construction  
 Location: Derby, NY Date: 06/05/24  
 Weather: Rain / Overcast Temperature: 82°F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 39133

Standard Counts: MS 698 DS 2013

Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	1 <sup>st</sup> Lift	131.6	1.8	92.8	*	New Wash Water Tank Subbase
2	1 <sup>st</sup> Lift	124.6	1.4	87.9	*	New Wash Water Tank Subbase
3	1 <sup>st</sup> Lift	129.5	1.6	91.3	*	New Wash Water Tank Subbase

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	141.8	6.3	2" ROC – NESL, Wehrle

Remarks: \* Proctor provided by client  
95% required compaction; All tests Failing

Technician: Chad Schwartz Date: 06/05/24  
 Reviewer Signature: *Ryan Hornstrom* Date: 06/14/2024



### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP88 Project No.: 24358  
 Client: Arcadis Contractor: STC Construction  
 Location: Derby, New York, 14047-9764 Date: 06-06-24  
 Weather: Overcast Temperature: 65 °F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 66437

Standard Counts: MS 1923 DS 639

Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	599.08	135.1	5.4	95.3	*	Washwater Tank
2	599.08	136.6	5.9	96.3	*	Washwater Tank
3	599.08	135.2	5.4	95.4	*	Washwater Tank
1	599.75	138.5	6.1	97.7	*	Washwater Tank
2	599.75	135.2	5.6	95.4	*	Washwater Tank
3	599.75	135.7	5.2	95.7	*	Washwater Tank

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	141.8	6.3	-2" R.O.C. Stone, NESL Wehrle Pit

Remarks: All lifts are 9" unless otherwise specified. 95% compaction required

Technician: Ethan Fideli Date: 06-06-24  
 Reviewer Signature: *Ryan Horvath* Date: 06/14/2024





### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP88 Project No.: 24358  
 Client: Arcadis Contractor: STC Construction  
 Location: Derby, NY Date: 06/07/24  
 Weather: Overcast Temperature: 68°F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 30484

Standard Counts: MS 584 DS 1903

Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	-3'	138.4	6.0	97.6	*	(A) See Map
2	-3'	135.4	4.9	95.5	*	(B) See Map
3	-3'	135.0	4.8	95.2	*	(C) See Map
4	-2' 3"	136.7	6.3	96.4	*	(D) See Map
5	-2' 3"	135.1	4.7	95.3	*	(E) See Map
6	-2' 3"	134.7	6.0	95.0	*	(F) See Map

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	141.8	6.3	2" ROC – NESL, Wehrle

Remarks: \* Proctor provided by client  
95% required compaction; client looking for moisture content to be 4.5% or greater

Technician: Daniel Langer Date: 06/07/24  
 Reviewer Signature: *Peter Hornstrom* Date: 06/14/2024





23 Mechanic Street  
Springville, NY 14141

295 Main Street  
West Seneca, NY 14224

encorus.com  
716.592.3980

### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP88  
Client: Arcadis  
Location: Derby, NY  
Weather: Overcast

Project No.: 24358  
Contractor: STC Construction  
Date: 06/10/24  
Temperature: 60°F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 28835

Standard Counts: MS 633 DS 1654

Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	-1' 6"	135.3	4.9	95.4	*	(A) See Map
2	-1' 6"	135.8	4.5	95.8	*	(B) See Map
3	-1' 6"	135.6	6.3	95.6	*	(C) See Map
4	-9"	135.0	4.5	95.2	*	(D) See Map
5	-9"	136.3	5.1	96.1	*	(E) See Map
6	-9"	135.4	4.7	95.5	*	(F) See Map
7	Grade	135.7	4.9	95.6	*	(G) See Map
8	Grade	136.0	4.6	95.9	*	(H) See Map
9	Grade	135.8	4.6	95.8	*	(I) See Map

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	141.8	6.3	2" ROC – NESL, Wehrle

Remarks: \* Proctor provided by client  
95% required compaction; client looking for moisture content to be 4.5% or greater

Technician: Daniel Langer Date: 06/10/24  
Reviewer Signature: Jeremy Lake Date: 06/21/2024

TEMPORARY GRAVEL  
CONTRACTOR SHALL  
PROVIDE ACCESS TO THE  
RAW WATER PUMP STATION  
AT ALL TIMES SEE DETAIL


(SEE NOTE 4)

TEMPORARY STABILIZED  
CONSTRUCTION ENTRANCE  
(SEE DETAIL ON SHEET C-13)  
(SEE NOTE 2)

CONTRACTOR STAGING/PARKING  
CLEAR AND GRADE AREA AS  
NECESSARY (SEE DETAIL)



WASHWATER TANK

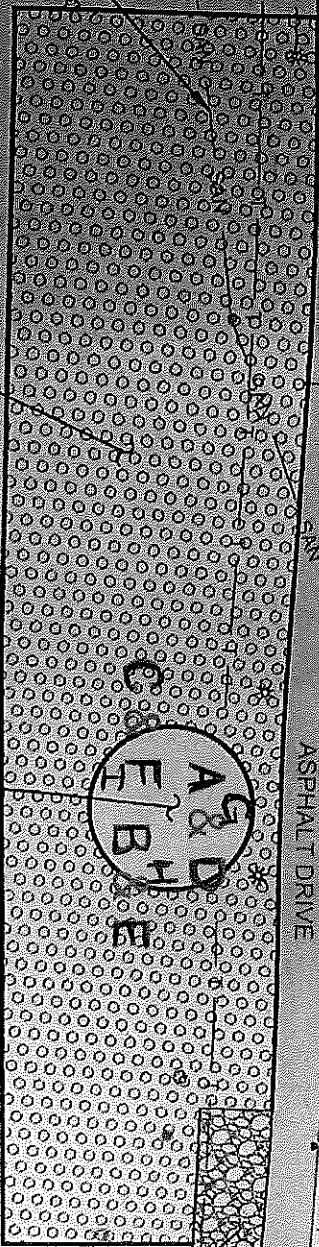

ASPHALT DRIVE

NOTE 2

WETLANDS (TYP.)

FILTER BUILDING

Sturgeon Point - Test Locations -

6/10/24



### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP88 Project No.: 24358  
 Client: Arcadis Contractor: STC Construction  
 Location: Derby, NY Date: 06/11/24  
 Weather: Overcast Temperature: 68°F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 28835

Standard Counts: MS 633 DS 1654


Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	6"	131.1	4.6	95.9	*	(A) See Map
2	6"	131.4	4.6	96.1	*	(B) See Map
3	6"	131.0	4.8	95.8	*	(C) See Map

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	136.7	7.5	1" ROC – NESL, Wehrle

Remarks: \* Proctor provided by client  
95% required compaction; client looking for moisture content to be 4.5% or greater

Technician: Daniel Langer Date: 06/11/24  
 Reviewer Signature: *Ryan Horvath* Date: 06/24/2024

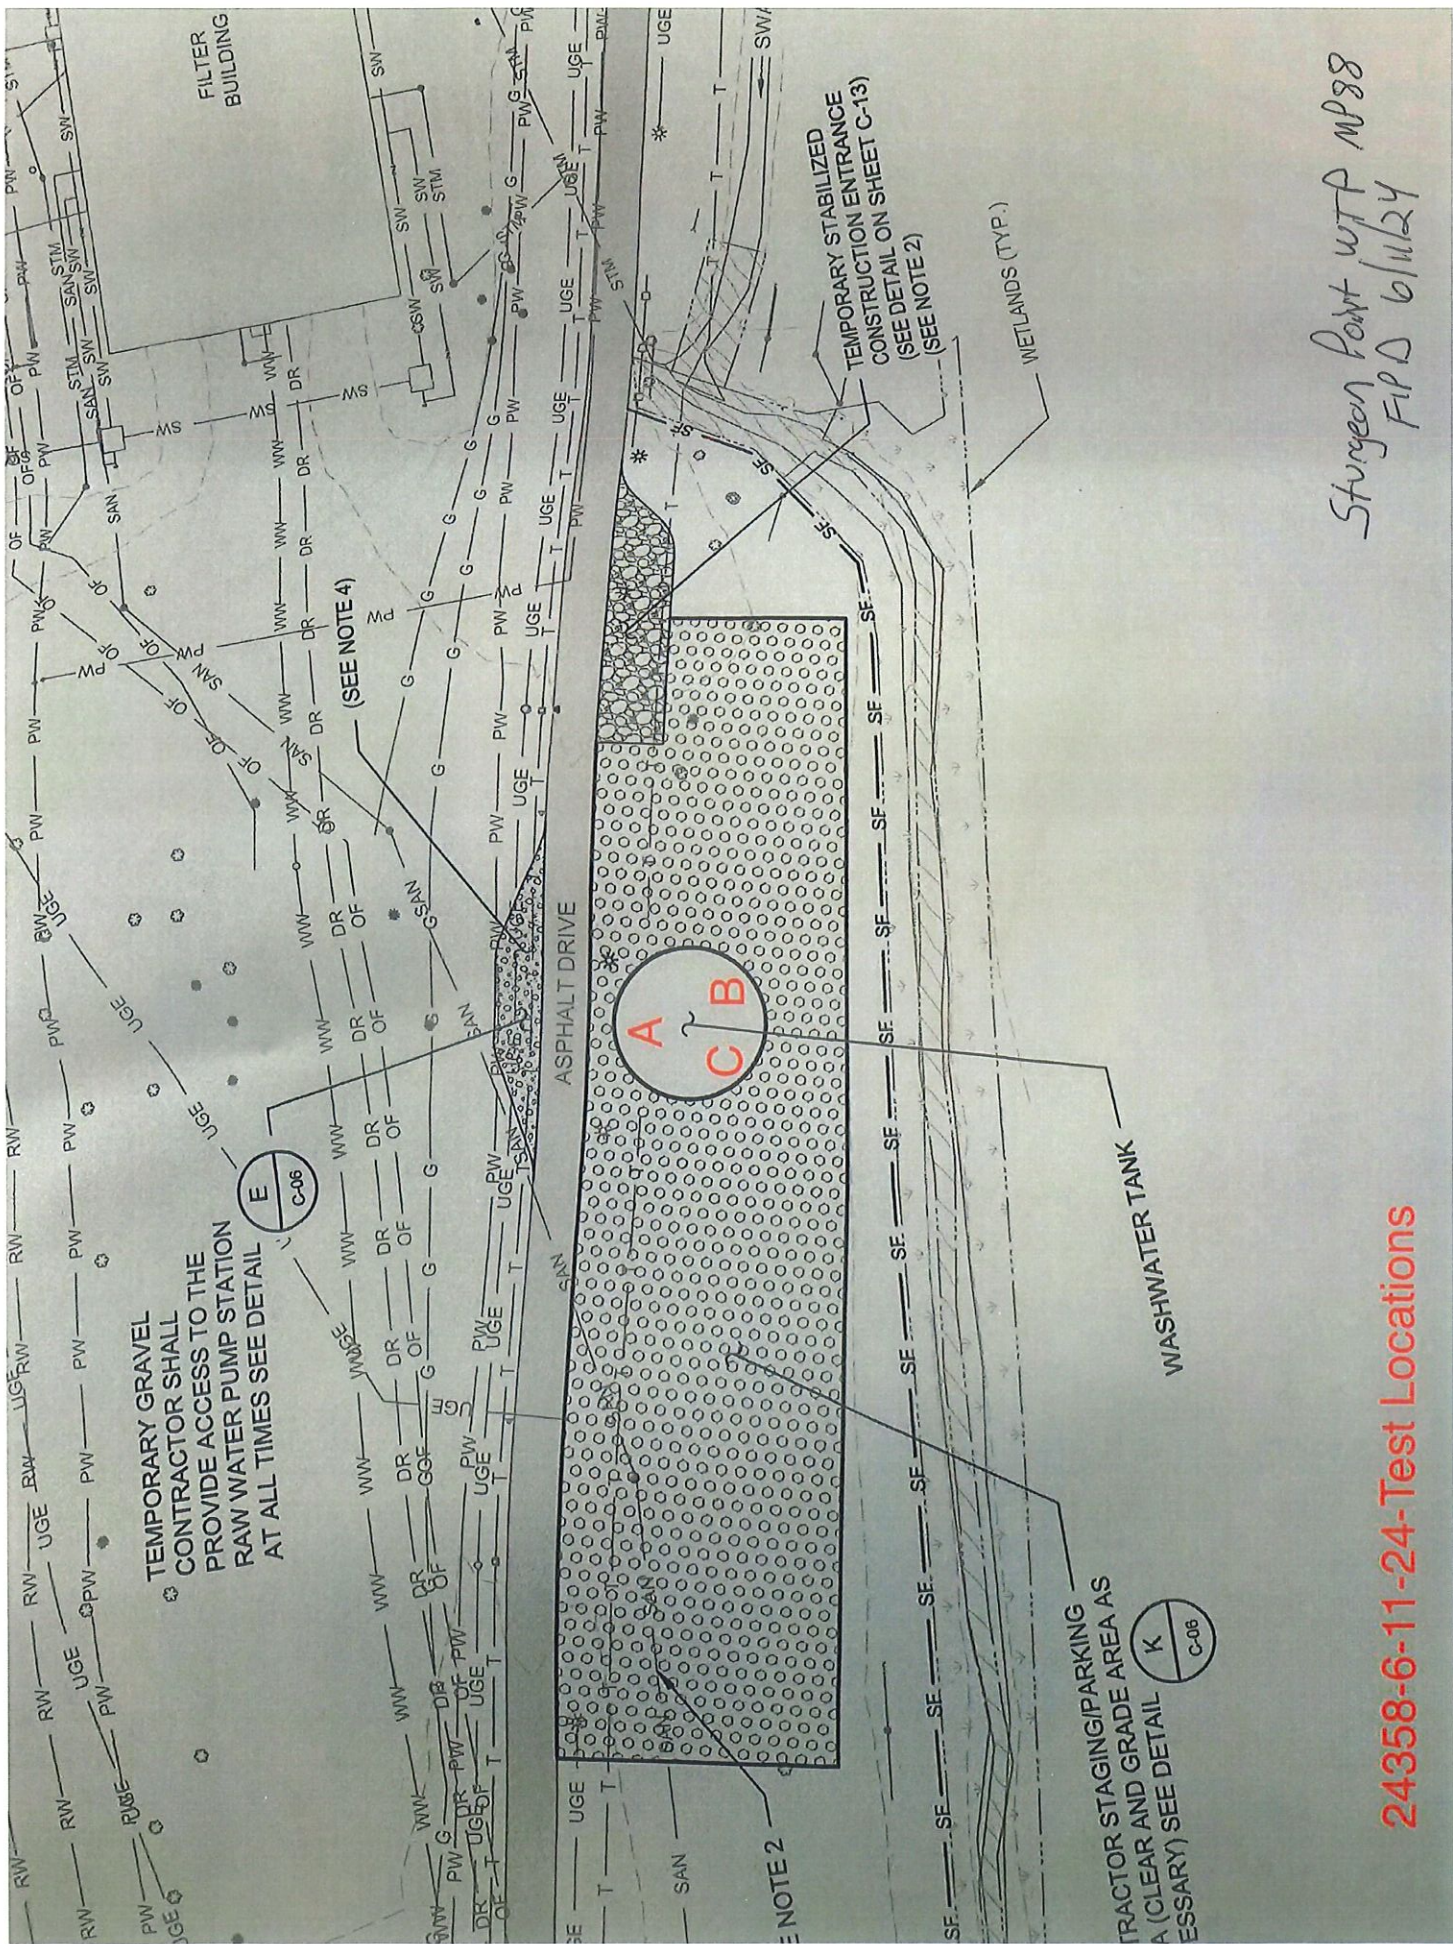

TEMPORARY GRAVEL CONSTRUCTOR SHALL PROVIDE ACCESS TO THE RAW WATER PUMP STATION AT ALL TIMES SEE DETAIL E (SEE NOTE 4)

TEMPORARY STABILIZED CONSTRUCTION ENTRANCE CONSTRUCTION ON SHEET C-13 (SEE NOTE 2)

TRACTOR STAGING/PARKING (A CLEAR AND GRADE AREA AS NECESSARY) SEE DETAIL K (SEE NOTE 2)

Sturgeon Point WTP MP88  
FIPD 6/11/24

24358-6-11-24-Test Locations



### FIELD IN PLACE DENSITY TEST REPORT

Project: Sturgeon Point WTP MP-88 Project No.: 24358  
 Client: Arcadis Contractor: STC Construction  
 Location: Derby, NY Date: 07-01-24  
 Weather: Clear Temperature: 56 °F

#### Troxler/Nuclear Density Gauge

Troxler/Nuclear Density Gauge (ID#, Make, Model, SN): 30484

Standard Counts: MS 1926 DS 589

Test #	Depth Or Elevation	In-Place Density (pcf)	In-Place Moisture (%)	% Compaction	Proctor Code	Location /Physical Description
1	0	135.0	5.8	95.2	*	Test Site A

Test Mode:  Direct Transmission  Back Scatter

Proctor Code	Maximum Density (pcf)	Optimum Moisture (%)	Material Type and Source
*	141.8	6.3	2" ROC - NESL, Wehrle

Remarks: \*Proctor provided by client  
95% required compaction

Technician: Ethan Fideli Date: 07-01-24  
 Reviewer Signature: *[Signature]* Date: 07/19/2024



## REPORT CONTINUATION SHEET

### Test Site





Title: Structural Fill Material Calculations

Date: 11/19/2024

Required Additional Stone Calculations

Ex. Grade	608	ft
Subgrade	599.75	ft
Addtl 16"	598.42	ft
Tank Radius	29.5	ft
Over Excav.	4	ft
Addtl. Horizontal	3.58	ft
Total Radius	37.083	ft
Executed Volume	1533	cy
Stone Hauled	3067	ton
Contract Volume	1077	cy
Additional Work Volume	456	cy
Additional Stone Hauled	912	ton